

# Quarterly Groundwater Monitoring Report Red Hill Fuel Storage Facility

Pearl Harbor, Oahu, Hawaii

Latitude: 21°22'15" N

Longitude: 157°53'33" W

HDOH Facility ID No. 9-102271

HDOH Release ID No. 99051, 010011, 020028

September 2009

Prepared by:



TEC Inc.  
1001 Bishop St. Suite 1400  
American Savings Bank Tower  
Honolulu, Hawaii 96813

Prepared for:



Commander  
Navy Region Hawaii  
Environmental Department, Code N45  
850 Ticonderoga Street, Suite 110  
Pearl Harbor, Hawaii 96860-5101

## Table of Contents

<i>Table of Contents</i> .....	i
<i>Executive Summary</i> .....	1
<i>1.0 Introduction</i> .....	6
1.1 Project Objective .....	6
1.2 Previous Reports .....	6
1.3 Background .....	7
1.3.1 Site Description .....	7
1.3.2 Facility Information .....	7
1.3.3 UST Information .....	7
1.4 Previous Environmental Investigations .....	7
1.5 Regulatory Updates .....	10
1.6 RHMW05 Installation .....	10
<i>2.0 Sample Collection and Analyses</i> .....	10
2.1 Monitoring Well Purging .....	11
2.2 Groundwater Sample Collection .....	11
2.3 Groundwater Sample Analyses .....	11
3.1 July 2009 Sample Analytical Results .....	15
3.2 Groundwater Contaminant Trend .....	16
3.3 Results of Oil/Water Interface Measurements .....	17
3.4 Groundwater Status .....	18
<i>4.0 Summary and Conclusions</i> .....	21
<i>5.0 References</i> .....	25

### List of Tables

Table 1 Analytical Results for Quarterly Groundwater Sampling Release Response Report ..	13
Table 2 MADEP Analytical Results .....	14
Table 3 Oil/Water Interface Measurements .....	18
Table 4 Action Levels for Compounds of Concern .....	18
Table 5 Results Categories and Responses to Groundwater Monitoring Results .....	19

### List of Figures

Figure 1 MADEP VPH/EPH Analyses .....	12
Figure 2 TPH Trends in Groundwater, Round 16 (July 15, 2009) .....	23
Figure 3 PAH Trends in Groundwater, Round 16 (July 15, 2009) .....	24

### List of Appendices

Appendix A – Laboratory Analytical Reports

## ***Executive Summary***

This quarterly groundwater monitoring report presents the results of groundwater sampling conducted on July 15, 2009 at the United States (US) Navy Bulk Fuel Storage Facility at Red Hill, Oahu, Hawaii (the Facility). The sampling and reporting was conducted by TEC Inc. (TEC) for the Fleet and Industrial Supply Center (FISC) at Pearl Harbor, Hawaii. This report is part of a series of quarterly groundwater monitoring reports provided by the US Navy to the State of Hawaii Department of Health (HDOH) in accordance with HDOH's release response requirements. Currently, there are 18 active and 2 inactive, 12.5 million gallon, field-constructed underground storage tanks (USTs) located at the Facility.

### ***Background***

In 2002, the US Navy installed a groundwater monitoring well (currently named RHMW01) into the basal aquifer, directly down-gradient from the Facility, within the lower access tunnel. Groundwater samples from this well indicated that petroleum from the Facility has migrated to the basal aquifer (AMEC, 2002). In 2005, the US Navy began quarterly monitoring of the aquifer to protect their down-gradient drinking water resource associated with the US Navy Well 2254-01. US Navy Well 2254-01 is located approximately 3,000 feet down-gradient from the Facility USTs and provides approximately 24 % of the potable water to the Pearl Harbor Water System (PHWS).

By September 2005, the US Navy had installed two more groundwater monitoring wells (RHMW02 and RHMW03) within the Facility UST system, a background groundwater monitoring well (RHMW04) up-gradient from the Facility adjacent to the US Navy Firing Range, and a groundwater monitoring well within the US Navy Well 2254-01 infiltration gallery (RHMW2254-01).

All five wells were sampled twice as part of a comprehensive environmental investigation and risk assessment (TEC, 2006). For this investigation, groundwater samples were analyzed for petroleum constituents and compared against HDOH Drinking Water Environmental Action Levels (EALs) (HDOH, July 2005). In addition, a three-dimensional (3-D) groundwater model was developed to produce site-specific risk-based levels (SSRBLs) for compounds of concern. The results of this modeling effort indicated that Jet Propulsion (JP)-5 fuel presented the biggest risk to the US Navy water supply, due to its mobility and toxicity. Finally, the model determined that a non-aqueous plume (free product) of JP-5 would need to migrate to within 1,100 feet of the US Navy Well 2254-01 infiltration gallery for HDOH EALs to be exceeded within the gallery. Based on this, free-product must be observed at RHMW01 for EALs to be exceeded at the US Navy Well 2254-01.

In April 2009, another groundwater monitoring well (RHMW05) was installed down-gradient from the Facility, within the lower access tunnel between RHMW01 and RHMW2254-01. It was installed to identify the extent of contaminant migration down-gradient before it reaches the infiltration gallery at RHMW2254-01 (see Figure 2).

During the summer and fall of 2008, HDOH updated their EALs, which resulted in significant changes to the action levels associated with methylnaphthalenes. The HDOH Drinking Water toxicity EAL for these compounds was 240 µg/L. This concentration assumed that methylnaphthalenes were not human carcinogens. Once evidence emerged and was accepted by the US Environmental Protection Agency (USEPA) that methylnaphthalenes are carcinogenic to humans, HDOH adopted more rigorous EALs of 4.7 µg/L for 1-methylnaphthalene and 24 µg/L for 2-methylnaphthalene (HDOH, 2008).

The HDOH Drinking Water EAL for naphthalene was also updated during this process. Previously, HDOH based their naphthalene EAL on USEPA Region 9 Preliminary Remediation Goal (USEPA PRG) of 6.2 µg/L, which is associated with a non-cancer Hazard Index of 1. In deference to the California Department of Public Health's Drinking Water Notification Levels, (HDOH, 2008) HDOH updated their naphthalene drinking water EAL to 17 µg/L.

Finally, the HDOH Drinking Water EAL for TPH-DRO was increased from 100 µg/L to 210 µg/L, although the Groundwater Gross Contamination EAL for TPH-DRO remains 100 µg/L.

### ***Groundwater Protection Plan***

In 2008, the US Navy completed the *Red Hill Bulk Fuel Storage Facility Final Groundwater Protection Plan* (TEC, 2008), which specified SSRBLs and various required actions based on the category status (i.e., categories 1 through 4) of each groundwater monitoring well. The main objective of the Plan is to protect the groundwater quality of US Navy Well 2254-01, which provides potable water to the PHWS. This is accomplished by comparing petroleum concentrations in the Facility wells to established SSRBLs and taking appropriate action. A secondary, but important objective of the Plan is to identify leaking USTs by evaluating increasing concentration trends, or the presence of free product in one or more groundwater monitoring wells. This quarterly report compares observed water quality to these established categories and associated actions.

### ***Current Results***

On July 15, 2009, five groundwater samples (i.e., RHMW01, RHMW02, RHMW03, RHMW05 and RHMW2254-01), along with the required quality control samples (duplicate, matrix spike, spike duplicate, and trip blank) were collected for analysis. Samples were analyzed for Total Petroleum Hydrocarbons (TPH) quantified as Diesel-Range Organics (DRO) and Gasoline Range Organics (GRO), Volatile Organic Compounds (VOCs), Polynuclear Aromatic Hydrocarbons (PAHs), and dissolved lead.

In addition, groundwater samples from RHMW01, RHMW02, and RHMW03 were analyzed by the Massachusetts Department of Environmental Protection (MADEP) method (see Figure 1) for Extractable Petroleum Hydrocarbons (EPH) and Volatile Petroleum Hydrocarbons (VPH).

### **TPH-DRO**

TPH-DRO was detected at 248 micrograms per liter (µg/L) in RHMW01, 1,375 µg/L (i.e., the average of normal and duplicate samples) in RHMW02, and at 491 µg/L in RHMW05 (i.e., the recently installed monitoring well). TPH-DRO was not detected above the laboratory method

detection limit (MDL) at RHMW03 and RHMW2254-01. The HDOH Drinking Water EAL and SSRBL for TPH-DRO are 210 µg/L and 4,500 µg/L, respectively.

#### TPH-GRO

For TPH-GRO the HDOH Drinking Water EAL is 100 µg/L. In samples RHMW01, RHMW02, RHMW02D (i.e., the duplicate sample collected), RHMW03, RHMW05, and RHMW2254-01 TPH-GRO was not observed above the laboratory MDL (i.e., 30 µg/L).

#### Other Parameters above HDOH Drinking Water EALs

At RHMW01, the concentration for 1-methylnaphthalene was 9.44 µg/L. At RHMW02, the average concentration between the normal and duplicate sample of 1-methylnaphthalene was 11.9 µg/L. Both these results are above the HDOH Drinking Water EAL for 1-methylnaphthalene of 4.7 µg/L.

#### MADEP-EPH and MADEP-VPH Results

EPH and VPH constituents were only detected above the laboratory MDL at RHMW02. At RHMW02, the average of the normal and duplicate samples for EPH C11 - C22 aromatics averaged 275 µg/L. For EPH C9 - C18 aliphatics, at RHMW02 the average of the normal and duplicate samples was 270 µg/L. The average concentration of the normal and duplicate samples at RHMW02 for total EPH was 545 µg/L.

Also at RHMW02, VPH C9 - C10 aromatics averaged a concentration of 455 µg/L. Total VPH was also detected at RHMW02 with an average concentration of 455 µg/L at RHMW02. A separate memorandum that discusses these EPH and VPH results relative to the companion TPH-DRO and TPH-GRO will be issued.

#### ***Trend Analysis***

The following is a discussion of compounds that exceeded HDOH Drinking Water EALs during two or more recent consecutive sampling events, thus establishing a trend:

#### RHMW01

At RHMW01, concentrations of TPH-DRO have been greater than the HDOH Drinking Water EAL since September 2005, but less than 25 percent of the SSRBL of 4,500 µg/L. In July 2009, the result of 248 µg/L TPH-DRO was lower in concentration than any previous round since September 2005. TPH-DRO at RHMW01 is exhibiting a decreasing trend.

#### RHMW02

At RHMW02, from September 2005 through February 2009, TPH-DRO exceeded the HDOH Drinking Water EAL and was greater than 50 percent of the SSRBL (estimated solubility limit of 4,500 µg/L). However, in May and July 2009, the average TPH-DRO concentrations (1,810 µg/L and 1,375 µg/L respectively) exceeded the HDOH Drinking Water EAL, but were below 50 percent of the SSRBL.

The July 2009 average TPH-DRO concentration represents the lowest concentration observed since September 2005. TPH-DRO is exhibiting a decreasing trend by having significantly

decreased over the last three sampling events (i.e., February, May, and July 2009). By way of comparison, in October 2008, the SSRBL for TPH-DRO of 4,500 µg/L was exceeded.

For other parameters, although the 1-methylnaphthalene average concentration (i.e., 11.9 µg/L) exceeded the HDOH Drinking Water EAL of 4.7 µg/L, there is a decreasing trend associated with 1-methylnaphthalene. The average concentrations of 1-methylnaphthalene observed during the October 2008, February 2009, May 2009, and July 2009 sampling events has respectively been 67.25 µg/L, 22 µg/L, 21.25 µg/L, and 11.9 µg/L.

#### RHMW03

At RHMW03, historically, concentrations of TPH-DRO have fluctuated around the HDOH Drinking Water EAL, but have been significantly lower than corresponding values observed at RHMW01 and RHMW02. However, during the last two sampling events (i.e., May and July 2009), TPH-DRO was not detected above the MDL. These results represent a continuing decreasing trend for TPH-DRO that has existed since October 2008.

#### RHMW05

At RHMW05 there is an increasing trend for TPH-DRO. The July concentration of TPH-DRO of 491 µg/L exhibited an increase as compared with the May 2009 concentration of 200 µg/L, the first sampling event for RHMW05. However, the July 2009 concentration is less than 25 percent of the SSRBL for TPH-DRO.

#### US Navy Well 2254-01

At US Navy Well 2254-01, trace concentrations of TPH-GRO and 2-methylnaphthalene that were observed in the February and May 2009 sampling events were not observed in July 2009. In addition, all other parameters were not detected as well.

#### **Current Groundwater Status**

To date, there is no observation of a trend (i.e., two or more consecutive events) of fuel presence on groundwater at any of the Facility monitoring wells.

#### US Navy Well 2254-01(measured at RHMW2254-01)

Based upon the July 2009 sampling event, the US Navy Well 2254-01 has been removed from the provisional category 1 status since no compounds were detected above the laboratory MDLs.

#### RHMW03

RHMW03 is no longer in Category 1 status because no compounds were detected above the laboratory MDL.

#### Category 1 Status Locations

There are no Category 1 status locations.

---

Category 2 Status Locations

**RHMW01**

The July 2009 sampling event indicates that RHMW01 should remain in Category 2 status. This is because the TPH-DRO concentration of 248 µg/L is greater than the HDOH Drinking Water EAL (210 µg/L), but less than half the SSRBL of 4,500 µg/L (estimated solubility limit of JP-5) and the 1-methylnaphthalene concentration (i.e., 9.44 µg/L) exceeded the HDOH Drinking Water EAL of 4.7 µg/L.

**RHMW02**

The July 2009 sampling event results in RHMW02 remaining in Category 2 status since TPH-DRO [1,450 µg/L and 1,300 µg/L (duplicate)] is greater than the HDOH Drinking Water EAL (210 µg/L), but is less than half the established SSRBL value of 4,500 µg/L and the 1-methylnaphthalene average concentration (i.e., 11.9 µg/L) exceeded the HDOH Drinking Water EAL of 4.7 µg/L.

**RHMW05**

Based upon the July 2009 sampling event, the second event for this newly installed well, RHMW05 now holds a Category 2 status. TPH-DRO at RHMW05 (i.e., 491µg/L) is above the drinking water EAL of 210 µg/L and has been showing an increasing trend over the last two rounds (i.e., 200 µg/L in May 2009 and 491µg/L in July 2009).

Category 2 for RHMW01, RHMW02, and RHMW05 requires:

1. Quarterly reports to be sent to HDOH; and
2. Initiation of a leak determination program to identify if tanks are leaking.

Category 3 or 4 Status Locations

There are no Category 3 or 4 status locations.

**Conclusions and Recommendations**

There is no indication of an immediate threat of disruption to drinking water resources of the US Navy Well 2254-01 as a result in the July 2009 data. Based upon the July 2009 data, the US Navy Well 2254-01 has been removed from the provisional Category 1 status that was established following the May 2009 sampling event.

With the exception of RHMW05, compound concentrations for all the other monitoring wells (i.e., RHMW01, -02, -03, and RHMW2254-01) are exhibiting decreasing contaminant trends and thus have improved in groundwater quality as compared to results from recent sampling events. In fact, the July 2009 event has resulted in RHMW03 being removed from Category 1 status.

Quarterly groundwater sampling for TPH-DRO, TPH-GRO, VOCs, PAHs, and dissolved lead will continue at the Facility until such time that data indicates that a different monitoring plan is warranted. It is recommended that future quarterly analytical results be closely assessed at RHMW05, since this is currently the only well exhibiting an increasing contaminant trend (i.e., 200 µg/L in May 2009 and 491µg/L in July 2009 for TPH-DRO).

## **1.0 Introduction**

This report presents the results of the 16<sup>th</sup> groundwater sampling event, conducted in July 2009 at the Red Hill Fuel Storage Facility, Oahu, Hawaii (hereafter referred to as “the Facility”). The Facility consists of 18 active and 2 inactive underground storage tanks (USTs) operated by the Fleet and Industrial Supply Center (FISC), Pearl Harbor. The groundwater sampling and analysis event is part of a groundwater monitoring program for the UST site in response to past UST releases, previous environmental investigations, and recommendations from the State of Hawaii Department of Health (HDOH).

### **1.1 Project Objective**

This groundwater sampling project was performed to evaluate the presence of chemicals of potential concern in groundwater underlying the Facility. The project was conducted to ensure the Navy remains in compliance with HDOH UST release response requirements as described in Hawaii Administrative Rules (HAR) 11-281 Subchapter 7, Release Response Action. The groundwater sampling program followed the procedures described in *Red Hill Bulk Fuel Storage Facility Groundwater Protection Plan* [TEC Inc. (TEC), 2008], also referred to as “the Plan”.

This groundwater sampling event was conducted by TEC under United States (US) Navy Contract Number N47408-04-D-8514, Task Order No. 54.

### **1.2 Previous Reports**

The following groundwater monitoring reports were previously submitted to the HDOH:

1. Groundwater Sampling Report, First Quarter 2005 (submitted April 2005);
2. Groundwater Sampling Report, Second Quarter 2005 (submitted August 2005);
3. Groundwater Sampling Report, Third Quarter 2005 (submitted November 2005);
4. Groundwater Sampling Report, Fourth Quarter 2005 (submitted February 2006);
5. Groundwater Monitoring Results, July 2006 (submitted September 2006);
6. Groundwater Monitoring Results, December 2006 (submitted January 2007);
7. Groundwater Monitoring Results, March 2007 (submitted May 2007);
8. Groundwater Monitoring Results, June 2007 (submitted August 2007);
9. Groundwater Monitoring Results, September 2007 (submitted October 2007);
10. Groundwater Monitoring Results, January 2008 (submitted March 2008);
11. Groundwater Monitoring Results, April 2008 (submitted May 2008);
12. Groundwater Monitoring Results, July 2008 (submitted October 2008);
13. Groundwater Monitoring Results, October and December 2008 (submitted February 2009);
14. Groundwater Monitoring Results, February 2009 (submitted May 2009); and



---

15. Groundwater Monitoring Results, May 2009 (submitted July 2009)

### **1.3 Background**

The following sections provide a description of the site and information on the Facility and USTs.

#### **1.3.1 Site Description**

The Facility is located in Halawa Heights on Oahu, Hawaii. Land adjacent to the north of the Facility is occupied by Halawa Correctional Facility and private businesses. Land to the south and west of the Facility includes the Coast Guard Reservation. Moanalua Valley is located east of the Facility (Dawson, 2006).

The Navy Public Works Department operates a potable water infiltration tunnel approximately 1,550 feet hydraulically down-gradient from the Facility (Dawson, 2006). The US Navy Well 2254-01 is located approximately 3,000 feet down-gradient (west) of the Facility and provides approximately 24% of the potable water to the Pearl Harbor Water System, which serves approximately 52,200 military consumers (TEC, 2008).

#### **1.3.2 Facility Information**

The Facility consists of 18 active and 2 inactive USTs operated by Navy FISC Pearl Harbor. Each UST has a capacity of 12.5 million gallons. The Facility is located approximately 100 feet above the basal aquifer (Dawson, 2006).

#### **1.3.3 UST Information**

The USTs were constructed in the early 1940s. The tanks were constructed of steel and currently contain Jet Propulsion (JP)-5 fuel and F-76 (diesel marine fuel). Previously, several tanks stored Navy Special Fuel Oil, Navy Distillate, aviation gasoline, and motor gasoline. Each tank measures approximately 245 feet in height and 100 feet in diameter. The upper domes of the tanks lie at depths varying between approximately 100 feet and 200 feet below the existing ground surface (TEC, 2006).

### **1.4 Previous Environmental Investigations**

**1998 to 2001:** From 1998 to 2001, the Navy conducted an investigation at the Facility to assess potential releases from the fuel storage USTs and piping systems. In February 2001, the Navy installed a one-inch diameter RHMW01 (previously known as MW-V1D) to monitor for contamination of the basal aquifer underlying the Facility. The well was installed and completed at approximately 100 feet below grade within the lower access tunnel. At the time of well completion, depth to water in RHMW01 was measured at 86 feet below grade (Dawson, 2006).

In February 2001, groundwater samples collected from RHMW01 contained total petroleum hydrocarbons (TPH) concentrations ranging from 883 micrograms per liter ( $\mu\text{g/L}$ ) to 1,050  $\mu\text{g/L}$  and total lead ranging from 10.4  $\mu\text{g/L}$  to 15  $\mu\text{g/L}$ . The maximum total lead concentration in the samples was equal to the primary drinking water standard of 15  $\mu\text{g/L}$  for lead and exceeded the HDOH Tier 1 groundwater action level of 5.6  $\mu\text{g/L}$  (Dawson, 2006).

**2005 – Groundwater Sampling:** The Navy began quarterly groundwater sampling at existing monitoring wells in 2005. Dawson Group, Inc. collected groundwater samples from RHMW01 and the Red Hill Navy Pump Station (US Navy Well 2254-01) in February, June, September, and December 2005.

Samples collected in February and June 2005 were not filtered in the field prior to analysis for lead. Analytical results for samples collected from RHMW01 indicated concentrations of total lead were above the HDOH Tier 1 action level of 5.6 µg/L. The results were not considered appropriate for risk assessment since the sample had not been filtered. In addition, lead was not a component of fuels from the tanks near RHMW01. Lead may have been part of the Facility construction material (TEC, 2007).

Samples were filtered in September and December 2005, and dissolved lead concentrations were below the HDOH Tier 1 action level. Concentrations of all other contaminants of potential concern were below HDOH Tier 1 action levels.

**2005 – Site Investigation:** As part of a site investigation, TEC installed three groundwater monitoring wells at the Facility between June and September 2005. Well RHMW02 was installed in the lower access tunnel near Tanks 5 and 6. Well RHMW03 was installed in the lower access tunnel near Tanks 13 and 14. Well RHMW04 was installed hydraulically upgradient of the USTs to provide geochemistry for water moving through the basal aquifer beneath the Facility. Wells RHMW02 and RHMW03 were completed to depths of approximately 125 feet below the tunnel floor, and well RHMW04 was completed to a depth of approximately 300 feet below ground surface outside the tunnel. Groundwater samples were collected from the three newly installed wells and two existing wells (RHMW01 and US Navy Well 2254-01) in September 2005.

Naphthalene and trichloroethylene were detected in samples collected from RHMW02 at concentrations greater than the HDOH Tier 1 action levels. Lead was detected in the sample collected from RHMW01 at a concentration greater than the HDOH Tier 1 action level; however, the sample was not filtered in the field prior to analysis. Analytical results for filtered samples obtained by Dawson during the same period indicated concentrations of dissolved lead were below the HDOH Tier 1 action level.

**2006 – Site Investigation:** Dedicated sampling pumps were installed in five wells (RHMW01, RHMW02, RHMW03, RHMW04, and US Navy Well 2254-01). TEC collected groundwater samples from the wells in July 2006. The groundwater samples were analyzed for petroleum constituents. Naphthalene was detected in samples collected from RHMW02 at concentrations above the HDOH Tier 1 action level.

In September 2005, with concurrence from the HDOH, the Navy decided to use the newer HDOH Environmental Action Levels (EALs) for the Red Hill Site Investigation and Risk Assessment project. The EALs are current and provide action levels for more chemicals, and are much more useful for conducting screening risk assessments. Since the HDOH (HDOH May 2005) Policy Letter stated that the two sets of action levels should not be mixed, the Tier 1

screening levels presented in HAR Section 11-281-78 would no longer be used to evaluate environmental impact at the Facility.

**2006 – Groundwater Sampling:** Groundwater samples were collected in December 2006. Analytical results indicated the following:

- No chemicals were detected in groundwater from US Navy Well 2254-01 or RHMW03;
- TPH as diesel range organics (TPH-DRO) was detected in groundwater above the HDOH Drinking Water EALs in RHMW01; and
- TPH as gasoline range organics (TPH-GRO), TPH-DRO, and naphthalene were detected in groundwater above the HDOH Drinking Water EALs in RHMW02.

**2007 – Groundwater Sampling:** Groundwater samples were collected in March, June, and September 2007. Analytical results indicated the following:

- No chemicals were detected above HDOH Drinking Water EALs at US Navy Well 2254-01;
- TPH-DRO exceeded HDOH Drinking Water EALs at RHMW01 during all three sampling events;
- TPH-GRO exceeded HDOH Drinking Water EALs at RHMW02 in March;
- TPH-DRO and naphthalene exceeded HDOH Drinking Water EALs at RHMW02 during all three sampling events;
- 1-methylnaphthalene and 2-methylnaphthalene exceeded the HDOH Groundwater Gross Contamination EAL at RHMW02 during all three sampling events; and
- TPH-DRO exceeded HDOH Drinking Water EALs at RHMW03 in June.

**2008 – Groundwater Sampling:** Groundwater samples were collected in January, April, July, and October 2008. Analytical results indicated the following:

- No chemicals were detected above HDOH Drinking Water EALs at US Navy Well 2254-01;
- Trace detections of 1-methylnaphthalene and naphthalene prompted a resample event in December at US Navy Well 2254-01, no chemicals were detected above the MDL;
- TPH-DRO exceeded HDOH Drinking Water EALs at RHMW01 during all four sampling events;
- TPH-GRO did not exceed HDOH Drinking Water EALs at RHMW02;
- TPH-DRO, naphthalene, 1-methylnaphthalene, and 2-methylnaphthalene exceeded HDOH Drinking Water EALs at RHMW02; and
- TPH-DRO exceeded HDOH Drinking Water EALs at RHMW03 during all four sampling events.

**2009 – Groundwater Sampling:** Groundwater samples were collected in February, May, and July 2009. Analytical results indicated the following:

- No chemicals have been detected above HDOH Drinking Water EALs at US Navy Well 2254-01;
- Trace TPH-GRO at US Navy Well 2254-01 was detected above the laboratory MDL and significantly below the laboratory reporting limit and HDOH EAL, but has most recently not been detected;

- TPH-DRO exceeded HDOH Drinking Water EALs at RHMW01;
- TPH-GRO has not exceed HDOH Drinking Water EALs at RHMW02;
- TPH-DRO, naphthalene, 1-methylnaphthalene, and 2-methylnaphthalene exceeded HDOH Drinking Water EALs at RHMW02, however most recently only TPH-DRO and 1-methylnaphthalene exceeded the HDOH Drinking Water EALs;
- TPH-DRO exceeded HDOH Drinking Water EALs at RHMW03 in February, but not in May or July; and
- TPH-DRO exceeded HDOH Drinking Water EAL at RHMW05 during the July 2009 sampling event.

### **1.5 Regulatory Updates**

During the summer and fall of 2008, HDOH updated their EALs, which resulted in significant changes to the action levels associated with methylnaphthalenes. The drinking water toxicity EAL for these compounds was 240 µg/L. This concentration presumed that methylnaphthalenes were non-carcinogenic. Evidence that they are human carcinogens has now been accepted by the US Environmental Protection Agency (USEPA). As a result, HDOH adopted more rigorous EALs of 4.7 µg/L for 1-methylnaphthalene and 24 µg/L for 2-methylnaphthalene, corresponding to a residential tap water scenario, and a 1 in a million cancer risk (HDOH, 2008).

The drinking water EAL for naphthalene has also been updated during this process. Previously, HDOH based their naphthalene EAL on USEPA Region 9 Preliminary Remediation Goal (USEPA PRG) of 6.2 µg/L, which is associated with a non-cancer Hazard Index of 1. HDOH has updated their naphthalene drinking water EAL to 17 µg/L, in deference to the California Department of Public Health's Drinking Water Notification Levels, a Hazard Index of 2.7 (HDOH, 2008).

Finally, the HDOH Drinking Water EAL for TPH-DRO was increased from 100 µg/L to 210 µg/L, although the HDOH Groundwater Gross Contamination EAL for TPH-DRO remains 100 µg/L.

### **1.6 RHMW05 Installation**

In April 2009, a new groundwater monitoring well, RHMW05, was installed by TEC under US Navy Contract Number N47408-04-D-8514, Task Order No. 54. RHMW05 is located down-gradient from the Facility, within the lower access tunnel between RHMW01 and RHMW2254-01 (located at the US Navy Well 2254-01). It was installed to identify the extent of contaminant migration down-gradient prior to contaminants reaching the infiltration gallery at the US Navy Well 2254-01.

## **2.0 Sample Collection and Analyses**

Field activities relating to groundwater sample collection were conducted on July 15, 2009. Groundwater samples were collected from four monitoring wells located inside the Facility lower access tunnel and one monitoring well located at the Red Hill Navy Pump Station. Sampling and analysis were conducted according to *Red Hill Bulk Fuel Storage Facility Groundwater Protection Plan* (TEC, 2009). A total of eight samples were collected as follows:

- one environmental sample from RHMW2254-01 (i.e., located at the US Navy Well 2254-01), RHMW01, RHMW02, RHMW03, and RHMW05;
- one duplicate sample from RHMW02 (sampled as RHMWA01 and reported as RHMW02D); and
- one matrix spike and matrix spike duplicate from RHMW2254-01.

## **2.1 Monitoring Well Purging**

All monitoring wells were purged prior to sampling. In general, well purging was considered complete when no less than three successive water quality parameter measurements had stabilized within approximately 10 percent. Field parameters were measured at regular intervals during well purging and included pH, temperature, specific conductivity, dissolved oxygen, and turbidity. At RHMW02 due to technical difficulties, in lieu of collecting field parameters, the well was sampled once the historically highest purge water volume was exceeded by over 20 percent. Purge water was collected and disposed in the Facility oil/water separator system.

## **2.2 Groundwater Sample Collection**


Each monitoring well was sampled immediately following purging. All wells were sampled directly from their dedicated bladder pump system, except for RHMW02 and RHMW05. RHMW02 and RHMW05 were sampled using disposable bailers. Samples were placed into sampling containers with appropriate preservatives [i.e., hydrochloric acid (HCl) for volatile organic analysis, nitric acid (HNO<sub>3</sub>) for dissolved lead]. Dissolved lead samples were filtered in the field and placed in preserved bottles. Sample containers were labeled with the date, sample identification number, type of analysis, and sampler's name. The containers were placed on ice in sample coolers and transported under chain-of-custody procedures to the certified laboratory for analysis.

## **2.3 Groundwater Sample Analyses**

Groundwater samples were analyzed by SGS Environmental Service, Inc. in Anchorage, Alaska for TPH-DRO and TPH-GRO by EPA Method 8015B, VOCs by EPA Method 8260B, PAHs by EPA Method 8270C SIM, and dissolved lead by EPA Method 6020. In addition, groundwater samples from RHMW01, RHMW02, and RHMW03 were analyzed by Test America in Westfield, Massachusetts for EPH and VPH by the MADEP method.

Figure 1 depicts the analytical relationship between samples analyzed for TPH-GRO/TPH-DRO and MADEP VPH/EPH. As seen in Figure 1, if the concentrations of the three EPH fractions and target PAH analytes were added together, it would be equal to a traditional "TPH" value. Similarly, if the three VPH fractions and BTEX/MtBE & naphthalene concentrations were added together, it would equal a GRO value.

**Figure 1. MADEP VPH/EPH Analyses**

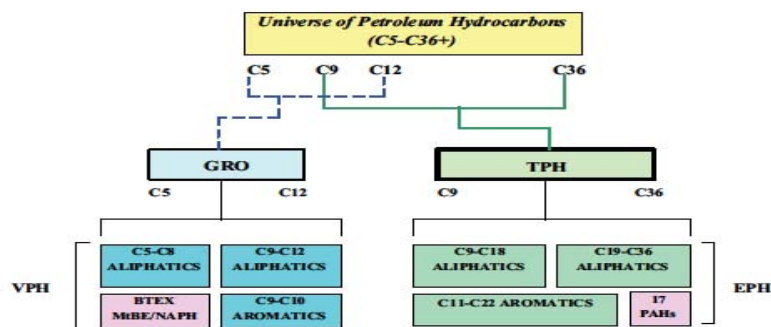

Source: Massachusetts Department of Environmental Protection, *Implementation of the MADEP VPH/EPH Approach*, Final Policy, October 31, 2002

### 3.0 Groundwater Sample Analytical Results

This section provides a summary of analytical results for groundwater samples collected from four monitoring wells located in the lower access tunnel of the Facility and one monitoring well located at the Red Hill Navy Pump Station. Duplicate sample results from monitoring well RHMW02 are reported in this document as RHMW02D. A summary of groundwater analytical results for TPH-DRO and TPH-GRO, VOCs, PAHs, and dissolved lead is included in Table 1. A summary of groundwater analytical results for the MADEP-EPH and MADEP-VPH is included in Table 2. Complete analytical laboratory reports are provided in Appendix A.



Table 2. MADEP Analytical Results for Quarterly Groundwater Monitoring Release Response Report (July 15, 2009)  
Red Hill Fuel Storage Facility, Pearl Harbor, Hawaii

Method	Chemical	HDOH Drinking Water EALs <sup>1</sup> for Human Toxicity UG/L	HDOH Groundwater Gross Contamination EALs <sup>2</sup> UG/L	RHMW01 UG/L July 15, 2009				RHMW02 UG/L July 15, 2009				RHMW02D UG/L July 15, 2009				RHMW03 UG/L July 15, 2009			
				Result	Q	MDL	RL	Result	Q	MDL	RL	Result	Q	MDL	RL	Result	Q	MDL	RL
				MADEP EPH	2-METHYLNAPHTHALENE	24	10	ND	U	10	10	ND	U	10	10	ND	U	10	10
	ACENAPHTHENE	370	20	ND	U	10	10	ND	U	10	10	ND	U	10	10	ND	U	10	10
	ACENAPHTHYLENE	240	2000	ND	U	10	10	ND	U	10	10	ND	U	10	10	ND	U	10	10
	ANTHRACENE	1800	22	ND	U	10	10	ND	U	10	10	ND	U	10	10	ND	U	10	10
	BENZO(a)ANTHRACENE	0.092	4.7	ND	U	10	10	ND	U	10	10	ND	U	10	10	ND	U	10	10
	BENZO(a)PYRENE	0.2	0.81	ND	U	10	10	ND	U	10	10	ND	U	10	10	ND	U	10	10
	BENZO(b)FLUORANTHENE	0.092	0.75	ND	U	10	10	ND	U	10	10	ND	U	10	10	ND	U	10	10
	BENZO(g,h,i)PERYLENE	1500	0.13	ND	U	10	10	ND	U	10	10	ND	U	10	10	ND	U	10	10
	BENZO(k)FLUORANTHENE	0.92	0.4	ND	U	10	10	ND	U	10	10	ND	U	10	10	ND	U	10	10
	TOTAL EXTRACTABLE PETROLEUM HYDROCARBONS	NS	NS	ND	U	100	100	540	U	100	100	550	U	100	100	ND	U	100	100
	CHRYSENE	9.2	1	ND	U	10	10	ND	U	10	10	ND	U	10	10	ND	U	10	10
	EXTRACTABLE PETROLEUM HYDROCARBONS C11-C22 AROMATIC	NS	NS	ND	U	100	100	270	U	100	100	280	U	100	100	ND	U	100	100
	EXTRACTABLE PETROLEUM HYDROCARBONS C19-C36 ALIPHATIC	NS	NS	ND	U	100	100	ND	U	100	100	ND	U	100	100	ND	U	100	100
	EXTRACTABLE PETROLEUM HYDROCARBONS C9-C18 ALIPHATIC	NS	NS	ND	U	100	100	270	U	100	100	270	U	100	100	ND	U	100	100
	FLUORANTHENE	1500	130	ND	U	10	10	ND	U	10	10	ND	U	10	10	ND	U	10	10
	FLUORENE	240	950	ND	U	10	10	ND	U	10	10	ND	U	10	10	ND	U	10	10
	INDENO(1,2,3-cd)PYRENE+DIBENZ(a,h)ANTHRACENE	NS	NS	ND	U	10	10	ND	U	10	10	ND	U	10	10	ND	U	10	10
	NAPHTHALENE	17	21	ND	U	10	10	ND	U	10	10	ND	U	10	10	ND	U	10	10
	PHENANTHRENE	240	410	ND	U	10	10	ND	U	10	10	ND	U	10	10	ND	U	10	10
	PYRENE	180	68	ND	U	10	10	ND	U	10	10	ND	U	10	10	ND	U	10	10
MADEP VPH	BENZENE	5	170	ND	U	5	5	ND	U	5	5	ND	U	5	5	ND	U	5	5
	ETHYLBENZENE	700	30	ND	U	5	5	ND	U	5	5	ND	U	5	5	ND	U	5	5
	M,P-XYLENE (SUM OF ISOMERS)	10000	20	ND	U	10	10	ND	U	10	10	ND	U	10	10	ND	U	10	10
	NAPHTHALENE	17	21	ND	U	10	10	ND	U	10	10	ND	U	10	10	ND	U	10	10
	O-XYLENE (1,2-DIMETHYLBENZENE)	NS	NS	ND	U	5	5	ND	U	5	5	ND	U	5	5	ND	U	5	5
	tert-BUTYL METHYL ETHER	NS	NS	ND	U	5	5	ND	U	5	5	ND	U	5	5	ND	U	5	5
	TOLUENE	1000	40	ND	U	5	5	ND	U	5	5	ND	U	5	5	ND	U	5	5
	TOTAL VOLATILE PETROLEUM HYDROCARBONS	NS	NS	ND	U	100	100	420	U	100	100	490	U	100	100	ND	U	100	100
	VOLATILE PETROLEUM HYDROCARBONS C5-C8 ALIPHATIC	NS	NS	ND	U	100	100	ND	U	100	100	ND	U	100	100	ND	U	100	100
	VOLATILE PETROLEUM HYDROCARBONS C9-C10 AROMATIC	NS	NS	ND	U	100	100	420	U	100	100	490	U	100	100	ND	U	100	100
	VOLATILE PETROLEUM HYDROCARBONS C9-C12 ALIPHATIC	NS	NS	ND	U	100	100	ND	U	100	100	ND	U	100	100	ND	U	100	100

MADEP EPH - Massachusetts Department of Environmental Protection Extractable Petroleum Hydrocarbons

MADEP VPH - Massachusetts Department of Environmental Protection Volatile Petroleum Hydrocarbons

UG/L - Micrograms per Liter

Q - Data qualifier

U - Indicates that the compound was analyzed for but not detected at or above the stated limit

<sup>1</sup> Final Drinking Water Action Levels for Human Toxicity, Table D-3a, *Screening for Environmental Concerns at Sites with Contaminated Soil and Groundwater*, HDOH, 2009

<sup>2</sup> Groundwater Gross Contamination Action Levels, Table G-1, *Screening for Environmental Concerns at Sites with Contaminated Soil and Groundwater*, HDOH, 2009

MDL - Method detection limit

RL - Reporting limit

ND - Indicates that the compound was not detected above the stated method detection limit

NS- Indicates that the EAL for the compound is not specified



### **3.1 July 2009 Sample Analytical Results**

All groundwater samples were analyzed for TPH-DRO, TPH-GRO, VOCs, PAHs, and dissolved lead. In addition, groundwater samples from RHMW01, RHMW02, and RHMW03 were analyzed by the Massachusetts Department of Environmental Protection (MADEP) method for Extractable Petroleum Hydrocarbons (EPH) and Volatile Petroleum Hydrocarbons (VPH).

The trip blank sample (i.e., a blank sample provided by the lab and transported with the sample bottles to detect the potential incursion of contaminants from outside sources) was analyzed for TPH-GRO, VOCs, and MADEP-VPH. The results for each groundwater monitoring well are discussed below.

#### RHMW01

TPH-DRO at 248 µg/L, and 1-methylnaphthalene at 9.44 µg/L exceeded the HDOH Drinking Water EALs of 210 µg/L and 4.7 µg/L, respectively. Trace concentrations of 2-methylnaphthalene, acenaphthene, chrysene, fluoranthene, fluorene, naphthalene, phenanthrene, and pyrene were detected below HDOH EALs (Table 1). All other constituents were not detected.

#### RHMW02

TPH-DRO, 1-methylnaphthalene, 2-methylnaphthalene, acenaphthene, chrysene, fluoranthene, fluorene, naphthalene, phenanthrene, and pyrene were detected at RHMW02. TPH-DRO was detected at RHMW02 in the normal and duplicate samples, at 1,450 µg/L and 1,300 µg/L, respectively. This result exceeded the HDOH EAL of 210 µg/L, but not the site-specific risk based level (SSRBL) of 4,500 µg/L. TPH-GRO was not detected above the laboratory MDL of 30 µg/L.

Naphthalene was analyzed by USEPA Method 8270C SIM and USEPA Method 8260B. USEPA Method 8260B produced the highest naphthalene concentrations, which averaged 10.65 µg/L from the normal and duplicate sample (HDOH Drinking Water EAL is 17 µg/L). In addition, 1-methylnaphthalene and 2-methylnaphthalene were detected by USEPA Method 8270C SIM in the normal and duplicate samples. The average result for 1-methylnaphthalene was 11.9 µg/L, exceeding the HDOH toxicity EAL of 4.7 µg/L. The average result for 2-methylnaphthalene was 3.12 µg/L, less than the HDOH Drinking Water EAL of 24 µg/L. All other petroleum constituents, including trace concentrations of acenaphthene, chrysene, fluoranthene, fluorene, naphthalene, phenanthrene, and pyrene were well below HDOH Drinking Water EALs at RHMW02 (Table 1).

Regarding MADEP analyses, RHMW02 was the only sample location that had EPH and VPH chemicals of concern above the laboratory MDL. At RHMW02, the average of the normal and duplicate samples for EPH C11 - C22 aromatics was 275 µg/L. For EPH C9 - C18 aliphatics, at RHMW02 the average of the normal and duplicate samples was 270 µg/L. The average concentration of the normal and duplicate samples at RHMW02 for total EPH was 545 µg/L (Table 2).

Also at RHMW02, VPH C9 - C10 aromatics averaged a concentration of 455 µg/L. Total VPH was also detected at RHMW02 with an average concentration of 455 µg/L at RHMW02. A separate memorandum that discusses these EPH and VPH results relative to the companion TPH-DRO and TPH-GRO will be issued (Table 2).

### RHMW03

No parameters were detected above the laboratory MDLs at RHMW03 (Table 1).

### RHMW05

TPH-DRO was detected at a concentration of 491 µg/L. This concentration exceeds the HDOH Drinking Water EAL of 210 µg/L and the HDOH Groundwater Gross Contamination EAL of 100 µg/L. All other parameters were not detected (Table 1).

### US Navy Well 2254-01

No parameters were detected above the laboratory MDLs at the US Navy Well 2254-01 (Table 1).

## **3.2 Groundwater Contaminant Trend**

Groundwater samples have been collected and analyzed by TEC since September 2005. Figure 2 shows TPH trends in groundwater at the Facility. Figure 3 shows PAH trends in groundwater at the Facility. In these figures, open icons (without data) represent locations where the compounds being analyzed were not detected.

The following is a discussion of compounds that exceeded HDOH Drinking Water EALs during two or more recent consecutive sampling events, thus establishing a trend:

### RHMW01

At RHMW01, concentrations of TPH-DRO have been greater than the HDOH Drinking Water EAL since September 2005, but less than 25 percent of the SSRBL of 4,500 µg/L. In July 2009, the result of 248 µg/L TPH-DRO was lower in concentration than any previous round since September 2005. TPH-DRO at RHMW01 is exhibiting a decreasing trend.

### RHMW02

At RHMW02, from September 2005 through February 2009, TPH-DRO exceeded the HDOH Drinking Water EAL and was greater than 50 percent of the SSRBL (estimated solubility limit of 4,500 µg/L). Specifically, the concentration of TPH-DRO was relatively stable at RHMW02 until July 2008, ranging from 2,250 to 2,995 µg/L. However, during the July and October 2008 sampling events, these average concentrations increased. The July 2008 average concentration was 4,055 µg/L and the October 2008 average concentration was 5,420 µg/L. Both of these values were significantly above the HDOH Drinking Water EAL of 210 µg/L, with the October 2008 average also exceeding the SSRBL of 4,500 µg/L.

However, TPH-DRO at RHMW02 has shown a decreasing trend since October 2008. Most recently, the May 2009 average TPH-DRO concentration (i.e., 1,810 µg/L) and the July 2009

TPH-DRO average concentration (i.e., 1,375 µg/L) exceeded the HDOH Drinking Water EAL, but were below 50 percent of the SSRBL of 4,500 µg/L.

The July 2009 average TPH-DRO concentration represents the lowest concentration observed at RHMW02 since September 2005. TPH-DRO concentrations have significantly decreased over the last three sampling events (i.e., February, May, and July 2009).

For other parameters, although the 1-methylnaphthalene average concentration (i.e., 11.9 µg/L) exceeded the HDOH Drinking Water EAL of 4.7 µg/L, there is a decreasing trend associated with 1-methylnaphthalene. The average concentrations of 1-methylnaphthalene observed during the October 2008, February 2009, May 2009, and July 2009 sampling events has respectively been 67.25 µg/L, 22 µg/L, 21.25 µg/L, and 11.9 µg/L.

#### RHMW03

At RHMW03, historically, concentrations of TPH-DRO have fluctuated around the HDOH Drinking Water EAL, but have been significantly lower than corresponding values observed at RHMW01 and RHMW02. However, during the last two sampling events (i.e., May and July 2009), TPH-DRO was not detected above the MDL. These results represent a continuing decreasing trend for TPH-DRO that has existed since October 2008.

#### RHMW05

At RHMW05 there is an increasing trend for TPH-DRO. The July concentration of TPH-DRO of 491 µg/L exhibited an increase as compared with the May 2009 concentration of 200 µg/L, the first sampling event for RHMW05. However, the July 2009 concentration is less than 25 percent of the SSRBL for TPH-DRO.

#### US Navy Well 2254-01

At US Navy Well 2254-01, trace concentrations of TPH-GRO and 2-methylnaphthalene that were observed in the February and May 2009 sampling events were not observed in July 2009. In addition, all other parameters were not detected as well.

### **3.3 Results of Oil/Water Interface Measurements**

The presence and thickness of light-non aqueous phased liquids (LNAPL), otherwise known as free product, released from the USTs is monitored at the Facility (see Table 3). Static water levels and fuel thickness is measured to a precision of ± 0.01 feet.

In January 2008, fuel was measured in monitoring wells RHMW01 and RHMW02 at a thickness of < 0.01 ft, but has not been observed in other monitoring wells. Measurements to determine the presence and thickness of fuel were conducted at RHMW01, RHMW02, RHMW03, and RHMW05 prior to the July 2009 sampling round. On August 21, a subsequent round of oil/water interface measurements was conducted. During the last two rounds of measurements, no free product was observed in any of these wells.

**Table 3. Oil/Water Interface Measurements**

Date	RHMW01		RHMW02		RHMW03		RHMW05	
	SWL (ft)	LNAPL (ft)	SWL (ft)	LNAPL (ft)	SWL (ft)	LNAPL (ft)	SWL (ft)	LNAPL (ft)
January 2008	17.74	< 0.01	18.78	< 0.01	NT <sup>1</sup>	NT <sup>1</sup>	----	----
July 2008	19.04	0.00	18.91	0.00	18.86	0.00	----	----
October 2008	18.61	0.00	18.56	0.00	18.82	0.00	----	----
November 2008	18.50	0.00	18.45	0.00	18.51	0.00	----	----
January 2009	19.28	0.00	19.22	0.00	19.27	0.00	----	----
February 2009	NT <sup>2</sup>	NT <sup>2</sup>	18.66	0.00	18.75	0.00	----	----
March 2009	18.59	0.00	18.57	0.00	18.67	0.00	----	----
May 2009 <sup>3</sup>	18.69	0.00	18.64	0.00	18.72	0.00	NT <sup>5</sup>	NT <sup>5</sup>
May 2009	18.91	0.00	18.86	0.00	18.90	0.00	NT <sup>5</sup>	NT <sup>5</sup>
July 2009 <sup>4</sup>	18.66	0.00	18.59	0.00	18.64	0.00	17.91	0.00
August 2009	18.37	0.00	18.30	0.00	18.47	0.00	17.49	0.00

SWL - Static water level, elevation above mean sea level (for RHMW05 this is estimated until the top well casing elevation has been determined)

LNAPL - Light Non-Aqueous Phased Liquid, fuel product on groundwater attributed to the Facility

ft - Feet

NT - Not Taken

<sup>1</sup> - The January 2008 measurement at RHMW03 was not taken due to equipment malfunction

<sup>2</sup> - During the February 2009 measurements, RHMW01 was inaccessible due to extensive work being conducted at Tank 02

<sup>3</sup> - The measurements scheduled for April 2009 were postponed until May 6, 2009 due to RHMW05 drilling activities

<sup>4</sup> - The June 2009 measurements were skipped due to the installation of dedicated oil/water interface probes

<sup>5</sup> - Oil/water interface measurements were not taken at RHMW05 until the installation of the oil/water interface probe was completed

---- - Time period prior to the installation of RHMW05

Oil/water interface measurements were not taken during in April 2008

### 3.4 Groundwater Status

Constituents of concern are defined as petroleum-related chemicals that have been observed in the groundwater samples above the HDOH EALs. In accordance with the *Red Hill Bulk Fuel Storage Facility Final Groundwater Protection Plan* (TEC, 2008), Table 4 defines the constituents of concern in groundwater at the Facility and the SSRBLs and updated EALs for each (HDOH 2008).

**Table 4. Action Levels for Constituents of Concern**

Chemical	EAL (µg/L)	SSRBL (µg/L)
<b>Petroleum Mixtures</b>		
TPH-DRO	210	4,500
TPH-GRO	100	4,500
<b>Semi-Volatile Compounds</b>		
1-Methylnaphthalene	4.7	NA
2-Methylnaphthalene	24	NA
Naphthalene	17	NA

NA – Not applicable or not determined

SSRBLs are applicable at RHMW01, RHMW02, RHMW03, and RHMW05

EALs are applicable at US Navy Well 2254-01

In addition, the Plan defines four results categories of groundwater status for the Facility, based on concentrations of constituents of concern in RHMW01, RHMW02, RHMW03 and the US Navy Well 2254-01, and requires specific responses when these categories are observed during quarterly groundwater sampling. Table 5 describes each of the four results categories and identifies response actions to be taken in accordance with the Plan.

**Table 5. Results Categories and Response Actions to Changes in Groundwater Status**

<b>Results Category</b>	<b>RHMW02 RHMW03 or RHMW05*</b>	<b>RHMW01</b>	<b>US Navy Pumping Well 2254-01</b>
Results Category 1: Result above detection limit but below drinking water EAL and trend for all compounds stable or decreasing	A	A	A,D,M,E
Results Category 2: Trend for any compound increasing or drinking water EAL exceeded	A, B	A, B	A,B,C,D,E,F,G,K, L,O
Results Category 3: Result Between 1/10X SSRBL and SSRBL for benzene, or between 1/2X SSRBL and SSRBL for TPH	A,B,G,H,I,J	A,B,E,G,H,I,J	A,B,C,D,E,F,G,I,J, K,L,O
Results Category 4: Result Exceeding any SSRBL or petroleum product observed	A,C,D,E,F,I,J, K,M,N	A,C,D,E,F,I, J,K,M,N,O	A,C,D,E,F,G,I,J,K, L,O

\*RHMW05 was installed in April 2009 and has been subsequently been added to this Table.

**Specific Responses:**

- A. Send quarterly reports to HDOH
- B. Begin program to determine the source of leak
- C. Notify HDOH verbally within 1 day and follow with written notification in 30 days
- D. Notify FISC Chain of Command within 1 day
- E. Send Type 1 Report (see box below) to HDOH
- F. Send Type 2 Report (see box below) to HDOH
- G. Increase monitoring frequency to once per month (if concentrations increasing)
- H. Notify HDOH verbally within 7 days and follow with written notification in 30 days
- I. Remove sampling pumps, measure product in pertinent wells with interface probe, re-install pumps if product is not detected.
- J. Immediately determine leaking tank
- K. Collect samples from nearby Halawa Deep Monitoring Well (2253-03) and OWDF MW01
- L. Provide alternative water source at 2254-01
- M. Prepare for alternative water source at US Navy Well 2254-01
- N. Re-measure for product every month with reports to HDOH
- O. Install additional monitoring well downgradient

### **Report Types**

#### HDOH Type 1 Report

- Re-evaluate Tier 3 Risk Assessment/groundwater model results
- Proposal to HDOH on a course of action

#### HDOH Type 2 Report

- Proposal for groundwater treatment

### Free Product Measurements

In response to the previous Category 3 status at RHMW02, free product measurements have been collected at the Facility monitoring wells (Table 3). To date, there is no trend (i.e., two or more consecutive events) of fuel presence on groundwater at any of these wells.

### US Navy Well 2254-01(measured at RHMW2254-01)

Based upon the July 2009 sampling event, the US Navy Well 2254-01 has been removed from the provisional category 1 status since no compounds were detected above the laboratory MDLs.

### RHMW03

RHMW03 is no longer in Category 1 status because no compounds were detected above the laboratory MDL.

### Category 1 Status Locations

There are no Category 1 status locations.

### Category 2 Status Locations

#### RHMW01

The July 2009 sampling event indicates that RHMW01 should remain in Category 2 status. This is because the TPH-DRO concentration of 248 µg/L is greater than the HDOH Drinking Water EAL (210 µg/L), but less than half the SSRBL of 4,500 µg/L (estimated solubility limit of JP-5) and the 1-methylnaphthalene concentration (i.e., 9.44 µg/L) exceeded the HDOH Drinking Water EAL of 4.7 µg/L.

#### RHMW02

The July 2009 sampling event results in RHMW02 remaining in Category 2 status since TPH-DRO [1,450 µg/L and 1,300 µg/L (duplicate)] is greater than the HDOH Drinking Water EAL (210 µg/L), but is less than half the established SSRBL value of 4,500 µg/L and the 1-methylnaphthalene average concentration (i.e., 11.9 µg/L) exceeded the HDOH Drinking Water EAL of 4.7 µg/L.

#### RHMW05

Based upon the July 2009 sampling event, the second event for this newly installed well, RHMW05 now holds a Category 2 status. TPH-DRO at RHMW05 (i.e., 491µg/L) is above the

drinking water EAL of 210 µg/L and has been showing an increasing trend over the last two rounds (i.e., 200 µg/L in May 2009 and 491µg/L in July 2009).

Category 2 for RHMW01, RHMW02, and RHMW05 requires:

1. Quarterly reports to be sent to HDOH; and
2. Initiation of a leak determination program to identify if tanks are leaking.

#### Category 3 or 4 Status Locations

There are no Category 3 or 4 status locations.

## **4.0 Summary and Conclusions**

### Summary

There is no indication of an immediate threat of disruption to drinking water resources of the US Navy Well 2254-01 as a result in the July 2009 data. As a result of the July 2009 sampling event, the US Navy Well 2254-01 has been removed from the provisional Category 1 status that was established following the May 2009 sampling event.




With the exception of RHMW05, compound concentrations for all other Facility monitoring wells (i.e., RHMW01, -02, -03, and RHMW2254-01) are exhibiting decreasing contaminant trends and thus have improved in groundwater quality relative to recent sampling events. In fact, the July 2009 event has resulted in RHMW03 being removed from Category 1 status. Currently, RHMW01, RHMW02, and RHMW05 are the only Facility wells with a Category status (i.e., Category 2 status).

### Conclusions/Recommendations

- To date, there is no trend (i.e., two or more consecutive events) of fuel presence on groundwater at the Facility wells (Table 3). In fact, fuel on the groundwater has been observed only once (i.e., in January 2008 in RHMW01 and RHMW02 at < 0.01 ft.). It is recommended that the Facility continue regular monitoring of Facility wells for the presence of fuel on groundwater.
- The concentration of TPH-DRO measured at the new monitoring well, RHMW05, in July 2009 (i.e., 491 µg/L) exceeded the HDOH Drinking Water EAL, but was less than half of the SSRBL. RHMW05 is located between RHMW01 and the US Navy Well 2254-01. It is recommended that future quarterly analytical results be closely assessed at RHMW05 since this is currently the only well exhibiting an increasing contaminant trend (i.e., 200 µg/L in May 2009 and 491µg/L in July 2009 for TPH-DRO).
- RHMW01, -02, -03, and RHMW2254-01 are exhibiting decreasing contaminant trends and thus have improved in groundwater quality relative to recent sampling events. It is recommended that quarterly monitoring of the Facility wells continue so that overall groundwater quality trends may be established/observed and proactive action taken if the groundwater quality begins to show evidence of deterioration.
- The US Navy Well 2254-01 is not imminently threatened at this time; however, monitoring should continue to evaluate the extent of contaminant migration from up-gradient locations.

- The following activities are planned to monitor and/or clarify the groundwater contamination situation at the Facility:
  1. Re-evaluate risk assessment and groundwater model (TEC, 2007) to ensure both are valid and protective of human health and the environment under the existing conditions;
  2. Continue monthly free product measurements at RHMW01, RHMW02, and RHMW03, and RHMW05;
  3. Collect samples from nearby Halawa Deep Monitoring Well (2253-03), OWDF MW01, and RHMW04 to assess regional groundwater trends;
  4. Prepare for alternative water source at US Navy Well 2254-01, if appropriate.
  5. Continue quarterly groundwater monitoring of Facility wells for TPH-DRO, TPH-GRO, VOCs, PAHs, and lead until such time that new data indicates that a different monitoring program is warranted.




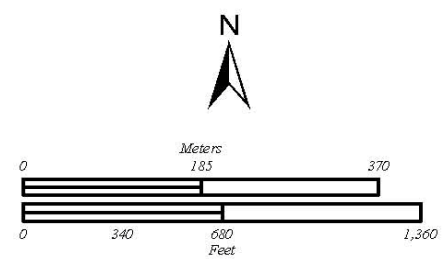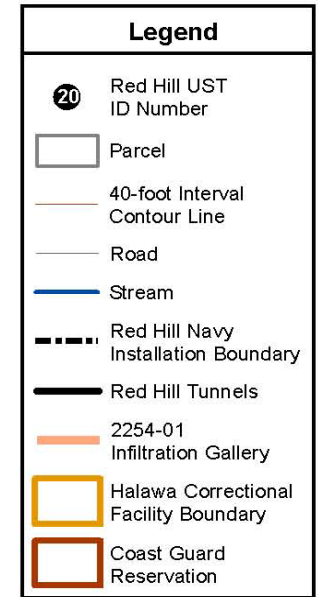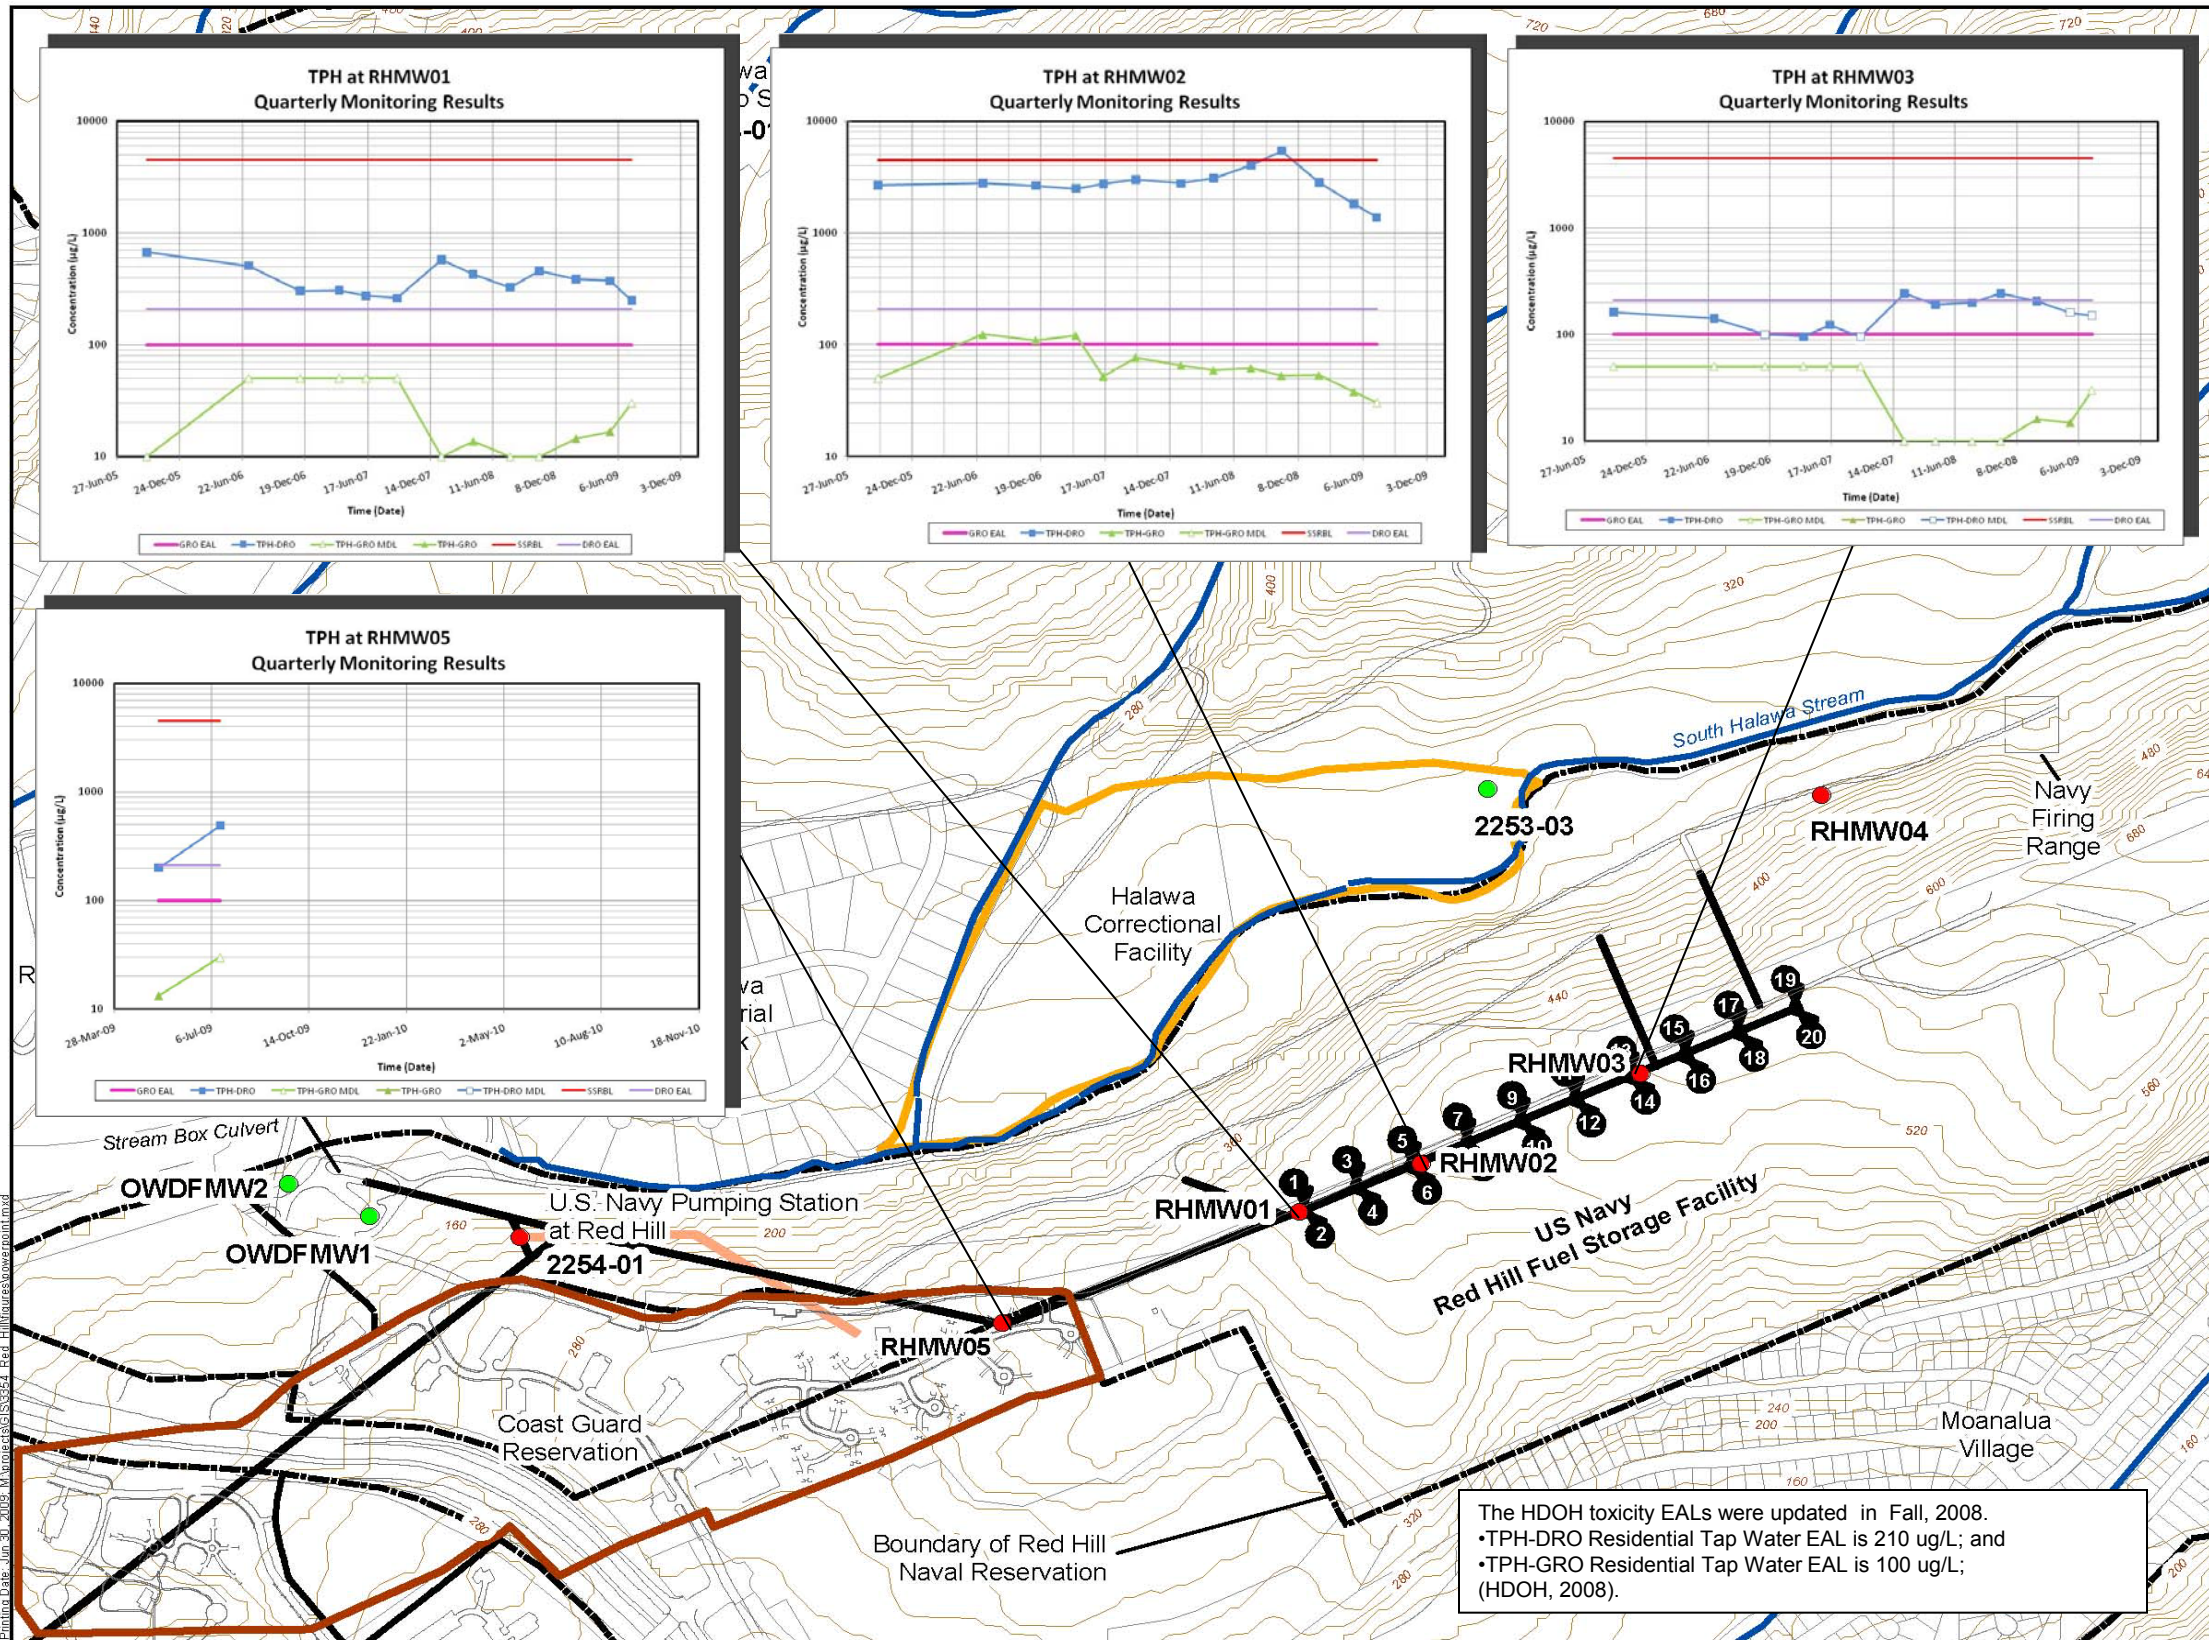

The HDOH toxicity EALs were updated in Fall, 2008.  
 •TPH-DRO Residential Tap Water EAL is 210 ug/L; and  
 •TPH-GRO Residential Tap Water EAL is 100 ug/L;  
 (HDOH, 2008).

**Figure**  
**TPH Trends in Groundwater**  
**Round 16 (July 15, 2009)**  
**Red Hill Fuel Storage Facility**  
**Oahu, Hawaii**



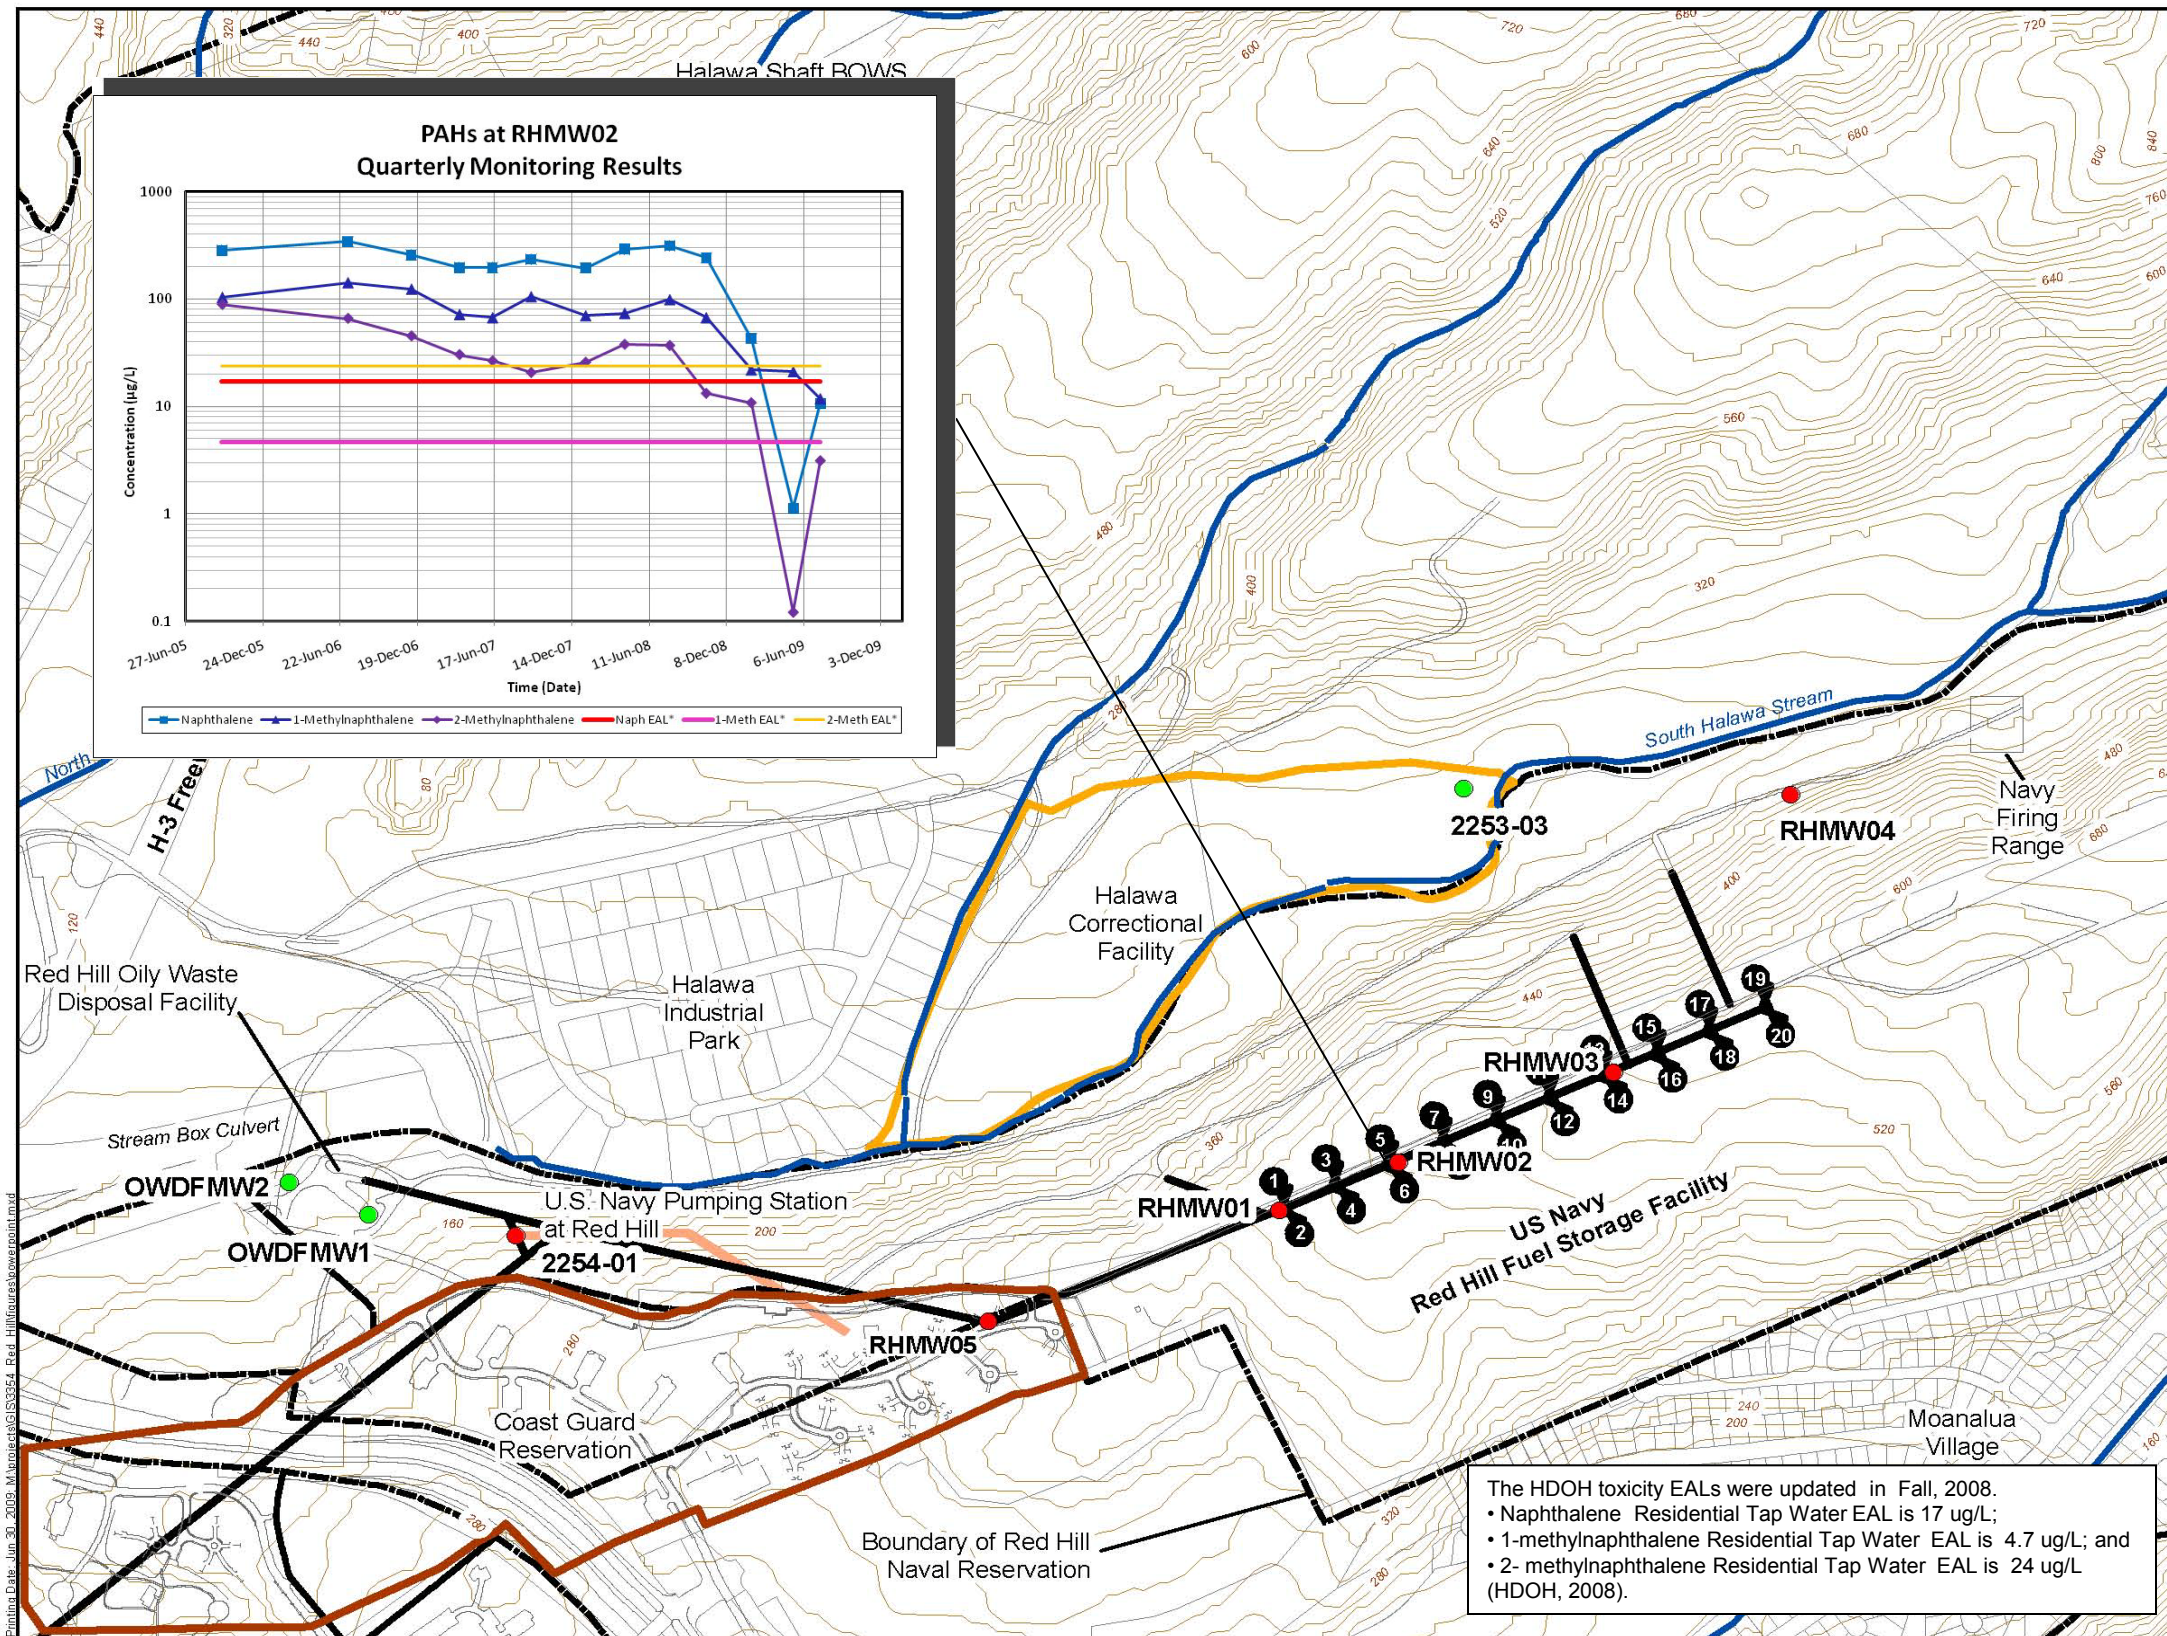

The HDOH toxicity EALs were updated in Fall, 2008.

- Naphthalene Residential Tap Water EAL is 17 µg/L;
- 1-methylnaphthalene Residential Tap Water EAL is 4.7 µg/L; and
- 2-methylnaphthalene Residential Tap Water EAL is 24 µg/L (HDOH, 2008).



**Figure**  
**PAH Trends in Groundwater**  
**Round 16 (July 15, 2009)**  
**Red Hill Fuel Storage Facility**  
**Oahu, Hawaii**



## 5.0 References

AMEC. *Red Hill Bulk Fuel Storage Facility Investigation Report*, Prepared for NAVFAC Pacific, August 2002.

Dawson Group, Inc. *Fourth Quarter 2005 Groundwater Sampling Report, Red Hill Fuel Storage Facility, Hawaii*. February 2006.

Hawaii Administrative Rules, Title 11, Chapter 281, Subchapter 7.

HDOH. *Screening for Environmental Concerns at Sites with Contaminated Soil and Groundwater, Summary Lookup Tables*. March 2009.

HDOH. *Use of May 2005 Environmental Action Levels (“EALs”) at Leaking Underground Storage Tank Sites*. Memo. July 2005.

HDOH. *Evaluation of Environmental Hazards at Sites with Contaminated Soil and Groundwater*. Summer 2008 (updated October 2008).

Massachusetts Department of Environmental Protection (MADEP). *Implementation of the MADEP VPH/EPH Approach*. Final Policy, October 2002

The Environmental Company, Inc. and AMEC. *Red Hill Bulk Fuel Storage Facility Work Plan, Pearl Harbor, Hawaii*. June 2005.

TEC, Inc. *Red Hill Bulk Fuel Storage Facility, Final – Addendum Planning Documents, Pearl Harbor, Hawaii*. May 2006.

TEC, Inc. *Red Hill Bulk Fuel Storage Facility, Final Technical Report, Pearl Harbor, Hawaii*. August 2007.

TEC, Inc. *Red Hill Bulk Fuel Storage Facility, Final Groundwater Protection Plan, Pearl Harbor, Hawaii*. January 2008.

***Appendix A***  
***Laboratory Analytical Reports***



**SGS North America Inc.**  
**Alaska Division**  
**Level II Laboratory Data Report**

Project: Red Hill BFSF  
Client: The Environmental Company, Inc. (TEC)  
SGS Work Order: 1093515

Released by:

**Contents:**

Cover Page  
Case Narrative  
Final Report Pages  
Quality Control Summary Forms  
Chain of Custody/Sample Receipt Forms

**Note:**  
Unless otherwise noted, all quality assurance/quality control criteria is in compliance with the standards set forth by the proper regulatory authority, the SGS Quality Assurance Program Plan, and the National Environmental Accreditation Conference.

# SGS North America Inc.

## Case Narrative

**Customer:** THEENVC

**The Environmental Company, Inc. (TEC)**

**Project:** 1093515

**Red Hill BFSF**

**NPDL WO:**

Refer to the sample receipt form for information on sample condition.

**1093515004 PS**

**RHMW05-WG16**

8015C - DRO - Unknown hydrocarbon with several peaks is present.

**1093515007 PS**

**RHMW02-WG16**

8015C - DRO - The pattern is consistent with a weathered middle distillate.

**1093515008 PS**

**RHMWA01-WG16**

8015C - DRO - The pattern is consistent with a weathered middle distillate.

**1093515002 BMS**

**RHMW2254-WG16 MS**

8015C - GRO - BMS recovery does not meet QC criteria (biased high). Refer to LCS for accuracy.



## Laboratory Analytical Report

Client: **The Environmental Company, Inc.**  
1001 Bishop Street, Suite 1400  
Honolulu, HI 96813

Attn: **Rick Adkisson**  
T: (808)528-1445 F:(808)528-0768

Project: **Red Hill BFSF**  
Workorder No.: **1093515**

Certification:

I certify that this data package is in compliance with the terms and conditions of the contract, both technically and for completeness, other than the conditions noted on the sample data sheet(s) and/or the case narrative. This certification applies only to the tested parameters and the specific sample(s) received at the laboratory.

If you have any questions regarding this report, or if we can be of further assistance, please contact your SGS Project Manager.

Tamara Rentz  
tamara.rentz@sgs.com  
Project Manager

Enclosed are the analytical results associated with this workorder.

As required by the state of Alaska and the USEPA, a formal Quality Assurance/Quality Control Program is maintained by SGS. A copy of our Quality Assurance Plan (QAP), which outlines this program is available at your request.

The Laboratory certification numbers are AK971-05 (DW), UTS-005 (CS) and AK00971 (Micro) for ADEC and AK100001 for NELAP (RCRA methods: 1020A, 1311, 6010B, 7470A, 7471A, 9040B, 9045C, 9056, 9060, 8015B, 8021B, 8081A/8082, 8260B, 8270C).

Except as specifically noted, all statements and data in this report are in conformance to the provisions set forth by the SGS QAP, the National Environmental Laboratory Accreditation Program and, when applicable, other regulatory authorities.

If you have any questions regarding this report or if we can be of any assistance, please contact your SGS Project Manager at 907-562-2343. All work is being provided under SGS general terms and conditions ([http://www.sgs.com/terms\\_and\\_conditions.htm](http://www.sgs.com/terms_and_conditions.htm))

The following descriptors may be found on your report which will serve to further qualify the data.

MDL	Method Detection Limit
PQL	Practical Quantitation Limit (reporting limit).
CL	Control Limit
U	Indicates the analyte was analyzed for but not detected.
F	Indicates value that is greater than or equal to the MDL.
J	The quantitation is an estimation.
ND	Indicates the analyte is not detected
B	Indicates the analyte is found in a blank associated with the sample.
*	The analyte has exceeded allowable regulatory or control limits.
D	The analyte concentration is the result of dilution.
GT	Greater Than
LT	Less Than
Q	QC parameter out of acceptance range.
M	A matrix effect was present.
E	The analyte result is above the calibrated range.
R	Rejected
DF	Analytical Dilution Factor
JL	The analyte was positively identified, but the quantitation is a low estimation.
<Surr>	Surrogate QC spiked standard
<Surr/IS>	Surrogate / Internal Standard QC spiked standard
QC	Quality Control
QA	Quality Assurance
MB	Method Blank
LCS (D)	Laboratory Control Sample (Duplicate)
MS(D)	Matrix Spike (Duplicate)
BMS(D)	Site Specific Matrix Spike (Duplicate)
RPD	Relative Percent Difference
ICV	Initial Calibration Verification
CCV	Continuous Calibration Verification
MSA	Method of Standard Addition

Notes: Soil samples are reported on a dry weight basis unless otherwise specified  
All DRO/RRO analyses are integrated per SOP.





SAMPLE SUMMARY

Print Date: 8/3/2009 4:39 pm

Client Name: The Environmental Company, Inc. (TEC)

Project Name: Red Hill BFSF

Workorder No.: 1093515

Analytical Methods

<u>Method Description</u>	<u>Analytical Method</u>
8270 PAH SIM Semi-Vol GC/MS Liq/Liq ext.	8270D SIMS
AFCEE 3.1 8260 (W)	SW8260B
Dissolved Metals by ICP-MS	SW6020
DRO by 8015B (W)	SW8015C
GRO (W)	SW8015C

Sample ID Cross Reference

<u>Lab Sample ID</u>	<u>Client Sample ID</u>
1093515001	RHMW2254-WG16
1093515002	RHMW2254-WG16 MS
1093515003	RHMW2254-WG16 MSD
1093515004	RHMW05-WG16
1093515005	RHMW01-WG16
1093515006	RHMW03-WG16
1093515007	RHMW02-WG16
1093515008	RHMWA01-WG16
1093515009	TB01-WG16



The Environmental Company, Inc. (TEC)

Print Date: 8/3/2009 4:39 pm

Client Sample ID: **RHMW2254-WG16**

SGS Ref. #: 1093515001

Project ID: Red Hill BFSF

Matrix: Water (Surface, Eff., Ground)

Collection Date/Time: 07/15/09 09:00

Receipt Date/Time: 07/17/09 11:00

**Dissolved Metals by ICP/MS**

<u>Parameter</u>	<u>Result</u>	<u>PQL/CL</u>	<u>MDL</u>	<u>Units</u>	<u>DF</u>	<u>Analytical</u> <u>Batch</u>	<u>Prep</u> <u>Batch</u>	<u>Qualifiers</u>
Lead	ND	1.00	0.310	ug/L	5	MMS5997	MXX21958	

**Batch Information**

Analytical Batch: MMS5997

Analytical Method: SW6020

Analysis Date/Time: 07/28/09 13:41

Dilution Factor: 5

Prep Batch: MXX21958

Prep Method: SW3010A

Prep Date/Time: 07/27/09 19:20

Initial Prep Wt./Vol.: 50 mL

Prep Extract Vol.: 50 mL

Container ID:1093515001-G

Analyst: NRB



Client Sample ID: **RHMW2254-WG16**

SGS Ref. #: 1093515001

Project ID: Red Hill BFSF

Matrix: Water (Surface, Eff., Ground)

Collection Date/Time: 07/15/09 09:00

Receipt Date/Time: 07/17/09 11:00

**Volatile Fuels Department**

<u>Parameter</u>	<u>Result</u>	<u>PQL/CL</u>	<u>MDL</u>	<u>Units</u>	<u>DF</u>	<u>Analytical</u> <u>Batch</u>	<u>Prep</u> <u>Batch</u>	<u>Qualifiers</u>
Gasoline Range Organics	ND	100	30.0	ug/L	1	VFC9556	VXX19707	
4-Bromofluorobenzene <sur>	91.2	50-150		%	1	VFC9556	VXX19707	

**Batch Information**

Analytical Batch: VFC9556

Analytical Method: SW8015C

Analysis Date/Time: 07/23/09 12:25

Dilution Factor: 1

Prep Batch: VXX19707

Prep Method: SW5030B

Prep Date/Time: 07/23/09 08:25

Initial Prep Wt./Vol.: 5 mL

Prep Extract Vol.: 5 mL

Container ID:1093515001-A

Analyst: KPW



Client Sample ID: **RHMW2254-WG16**

SGS Ref. #: 1093515001

Project ID: Red Hill BFSF

Matrix: Water (Surface, Eff., Ground)

Collection Date/Time: 07/15/09 09:00

Receipt Date/Time: 07/17/09 11:00

**Semivolatile Organic Fuels Department**

<u>Parameter</u>	<u>Result</u>	<u>PQL/CL</u>	<u>MDL</u>	<u>Units</u>	<u>DF</u>	<u>Analytical Batch</u>	<u>Prep Batch</u>	<u>Qualifiers</u>
Diesel Range Organics	ND	0.435	0.163	mg/L	1	XFC8727	XXX21224	
5a Androstane <sur>	93.1	50-150		%	1	XFC8727	XXX21224	

**Batch Information**

Analytical Batch: XFC8727

Analytical Method: SW8015C

Analysis Date/Time: 07/30/09 02:25

Dilution Factor: 1

Prep Batch: XXX21224

Prep Method: SW3520C

Prep Date/Time: 07/21/09 10:15

Initial Prep Wt./Vol.: 920 mL

Prep Extract Vol.: 1 mL

Container ID:1093515001-H

Analyst: KDC

Client Sample ID: **RHMW2254-WG16**

SGS Ref. #: 1093515001

Project ID: Red Hill BFSF

Matrix: Water (Surface, Eff., Ground)

Collection Date/Time: 07/15/09 09:00

Receipt Date/Time: 07/17/09 11:00

**Volatile Gas Chromatography/Mass Spectroscopy**

<u>Parameter</u>	<u>Result</u>	<u>PQL/CL</u>	<u>MDL</u>	<u>Units</u>	<u>DF</u>	<u>Analytical</u> <u>Batch</u>	<u>Prep</u> <u>Batch</u>	<u>Qualifiers</u>
Benzene	ND	0.400	0.120	ug/L	1	VMS10654	VXX19686	
Toluene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Ethylbenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
n-Butylbenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,4-Dichlorobenzene	ND	0.500	0.150	ug/L	1	VMS10654	VXX19686	
1,2-Dichloroethane	ND	0.500	0.150	ug/L	1	VMS10654	VXX19686	
1,3,5-Trimethylbenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
4-Chlorotoluene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Chlorobenzene	ND	0.500	0.150	ug/L	1	VMS10654	VXX19686	
4-Methyl-2-pentanone (MIBK)	ND	10.0	3.10	ug/L	1	VMS10654	VXX19686	
cis-1,2-Dichloroethene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
4-Isopropyltoluene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
cis-1,3-Dichloropropene	ND	0.500	0.150	ug/L	1	VMS10654	VXX19686	
n-Propylbenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Styrene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Dibromomethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
trans-1,3-Dichloropropene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,2,4-Trichlorobenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Acetone	ND	10.0	3.10	ug/L	1	VMS10654	VXX19686	
1,1,2,2-Tetrachloroethane	ND	0.500	0.150	ug/L	1	VMS10654	VXX19686	
1,2-Dibromo-3-chloropropane	ND	2.00	0.620	ug/L	1	VMS10654	VXX19686	
Methyl-t-butyl ether	ND	5.00	1.50	ug/L	1	VMS10654	VXX19686	
Tetrachloroethene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Dibromochloromethane	ND	0.500	0.150	ug/L	1	VMS10654	VXX19686	
1,3-Dichloropropane	ND	0.400	0.120	ug/L	1	VMS10654	VXX19686	
1,2-Dibromoethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Carbon tetrachloride	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,1,1,2-Tetrachloroethane	ND	0.500	0.150	ug/L	1	VMS10654	VXX19686	
Chloroform	ND	1.00	0.300	ug/L	1	VMS10654	VXX19686	
Bromobenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Chloromethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,2,3-Trichloropropane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Bromomethane	ND	3.00	0.940	ug/L	1	VMS10654	VXX19686	
Bromochloromethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Vinyl chloride	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Dichlorodifluoromethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	



Client Sample ID: **RHMW2254-WG16**

SGS Ref. #: 1093515001

Project ID: Red Hill BFSF

Matrix: Water (Surface, Eff., Ground)

Collection Date/Time: 07/15/09 09:00

Receipt Date/Time: 07/17/09 11:00

**Volatile Gas Chromatography/Mass Spectroscopy**

<u>Parameter</u>	<u>Result</u>	<u>PQL/CL</u>	<u>MDL</u>	<u>Units</u>	<u>DF</u>	<u>Analytical Batch</u>	<u>Prep Batch</u>	<u>Qualifiers</u>
Chloroethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
sec-Butylbenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Bromodichloromethane	ND	0.500	0.150	ug/L	1	VMS10654	VXX19686	
1,1-Dichloroethene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
2-Butanone (MEK)	ND	10.0	3.10	ug/L	1	VMS10654	VXX19686	
Methylene chloride	ND	5.00	1.00	ug/L	1	VMS10654	VXX19686	
Trichlorofluoromethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
P & M -Xylene	ND	2.00	0.620	ug/L	1	VMS10654	VXX19686	
Naphthalene	ND	2.00	0.620	ug/L	1	VMS10654	VXX19686	
o-Xylene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Bromoform	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1-Chlorohexane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,2,4-Trimethylbenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
tert-Butylbenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,1,1-Trichloroethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,1-Dichloroethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
2-Chlorotoluene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Trichloroethene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
trans-1,2-Dichloroethene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,2-Dichlorobenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
2,2-Dichloropropane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Hexachlorobutadiene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Isopropylbenzene (Cumene)	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,2-Dichloropropane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,1-Dichloropropene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,1,2-Trichloroethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,3-Dichlorobenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,2,3-Trichlorobenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,2-Dichloroethane-D4 <surr>	108	73-120		%	1	VMS10654	VXX19686	
Toluene-d8 <surr>	99	80-120		%	1	VMS10654	VXX19686	
4-Bromofluorobenzene <surr>	104	76-120		%	1	VMS10654	VXX19686	

**Batch Information**

Analytical Batch: VMS10654  
Analytical Method: SW8260B  
Analysis Date/Time: 07/20/09 18:57  
Dilution Factor: 1

Prep Batch: VXX19686  
Prep Method: SW5030B  
Prep Date/Time: 07/20/09 12:19

Initial Prep Wt./Vol.: 5 mL  
Prep Extract Vol.: 5 mL  
Container ID:1093515001-D  
Analyst: DSH



Client Sample ID: **RHMW2254-WG16**

SGS Ref. #: 1093515001

Project ID: Red Hill BFSF

Matrix: Water (Surface, Eff., Ground)

Collection Date/Time: 07/15/09 09:00

Receipt Date/Time: 07/17/09 11:00

**Polynuclear Aromatics GC/MS**

<u>Parameter</u>	<u>Result</u>	<u>PQL/CL</u>	<u>MDL</u>	<u>Units</u>	<u>DF</u>	<u>Analytical Batch</u>	<u>Prep Batch</u>	<u>Qualifiers</u>
Acenaphthylene	ND	0.0549	0.0165	ug/L	1	XMS4994	XXX21226	
Acenaphthene	ND	0.0549	0.0165	ug/L	1	XMS4994	XXX21226	
Fluorene	ND	0.0549	0.0165	ug/L	1	XMS4994	XXX21226	
Phenanthrene	ND	0.0549	0.0165	ug/L	1	XMS4994	XXX21226	
Anthracene	ND	0.0549	0.0165	ug/L	1	XMS4994	XXX21226	
Fluoranthene	ND	0.0549	0.0165	ug/L	1	XMS4994	XXX21226	
Pyrene	ND	0.0549	0.0165	ug/L	1	XMS4994	XXX21226	
Benzo(a)Anthracene	ND	0.0549	0.0165	ug/L	1	XMS4994	XXX21226	
Chrysene	ND	0.0549	0.0165	ug/L	1	XMS4994	XXX21226	
Benzo[b]Fluoranthene	ND	0.0549	0.0165	ug/L	1	XMS4994	XXX21226	
Benzo[k]fluoranthene	ND	0.0549	0.0165	ug/L	1	XMS4994	XXX21226	
Benzo[a]pyrene	ND	0.0549	0.0165	ug/L	1	XMS4994	XXX21226	
Indeno[1,2,3-c,d] pyrene	ND	0.0549	0.0165	ug/L	1	XMS4994	XXX21226	
Dibenzo[a,h]anthracene	ND	0.0549	0.0165	ug/L	1	XMS4994	XXX21226	
Benzo[g,h,i]perylene	ND	0.0549	0.0165	ug/L	1	XMS4994	XXX21226	
Naphthalene	ND	0.110	0.0341	ug/L	1	XMS4994	XXX21226	
1-Methylnaphthalene	ND	0.0549	0.0165	ug/L	1	XMS4994	XXX21226	
2-Methylnaphthalene	ND	0.0549	0.0165	ug/L	1	XMS4994	XXX21226	
Terphenyl-d14 <sur>	96.7	50-135		%	1	XMS4994	XXX21226	

**Batch Information**

Analytical Batch: XMS4994

Analytical Method: 8270D SIMS

Analysis Date/Time: 07/22/09 04:48

Dilution Factor: 1

Prep Batch: XXX21226

Prep Method: SW3520C

Prep Date/Time: 07/21/09 10:40

Initial Prep Wt./Vol.: 910 mL

Prep Extract Vol.: 1 mL

Container ID:1093515001-J

Analyst: JDH



The Environmental Company, Inc. (TEC)

Print Date: 8/3/2009 4:39 pm

Client Sample ID: **RHMW05-WG16**

SGS Ref. #: 1093515004

Project ID: Red Hill BFSF

Matrix: Water (Surface, Eff., Ground)

Collection Date/Time: 07/15/09 07:35

Receipt Date/Time: 07/17/09 11:00

**Dissolved Metals by ICP/MS**

<u>Parameter</u>	<u>Result</u>	<u>PQL/CL</u>	<u>MDL</u>	<u>Units</u>	<u>DF</u>	<u>Analytical Batch</u>	<u>Prep Batch</u>	<u>Qualifiers</u>
Lead	ND	1.00	0.310	ug/L	5	MMS5997	MXX21958	

**Batch Information**

Analytical Batch: MMS5997

Analytical Method: SW6020

Analysis Date/Time: 07/28/09 14:07

Dilution Factor: 5

Prep Batch: MXX21958

Prep Method: SW3010A

Prep Date/Time: 07/27/09 19:20

Initial Prep Wt./Vol.: 50 mL

Prep Extract Vol.: 50 mL

Container ID:1093515004-G

Analyst: NRB





Client Sample ID: **RHMW05-WG16**  
SGS Ref. #: 1093515004  
Project ID: Red Hill BFSF  
Matrix: Water (Surface, Eff., Ground)

Collection Date/Time: 07/15/09 07:35  
Receipt Date/Time: 07/17/09 11:00

**Volatile Fuels Department**

<u>Parameter</u>	<u>Result</u>	<u>PQL/CL</u>	<u>MDL</u>	<u>Units</u>	<u>DF</u>	<u>Analytical Batch</u>	<u>Prep Batch</u>	<u>Qualifiers</u>
Gasoline Range Organics	ND	100	30.0	ug/L	1	VFC9556	VXX19707	
4-Bromofluorobenzene <sur>	99.8	50-150		%	1	VFC9556	VXX19707	

**Batch Information**

Analytical Batch: VFC9556  
Analytical Method: SW8015C  
Analysis Date/Time: 07/23/09 10:50  
Dilution Factor: 1

Prep Batch: VXX19707  
Prep Method: SW5030B  
Prep Date/Time: 07/23/09 08:25

Initial Prep Wt./Vol.: 5 mL  
Prep Extract Vol.: 5 mL  
Container ID:1093515004-A  
Analyst: KPW



Client Sample ID: **RHMW05-WG16**

SGS Ref. #: 1093515004

Project ID: Red Hill BFSF

Matrix: Water (Surface, Eff., Ground)

Collection Date/Time: 07/15/09 07:35

Receipt Date/Time: 07/17/09 11:00

**Semivolatile Organic Fuels Department**

<u>Parameter</u>	<u>Result</u>	<u>PQL/CL</u>	<u>MDL</u>	<u>Units</u>	<u>DF</u>	<u>Analytical Batch</u>	<u>Prep Batch</u>	<u>Qualifiers</u>
Diesel Range Organics	0.491	0.421	0.158	mg/L	1	XFC8727	XXX21224	
5a Androstane <sur>	83.1	50-150		%	1	XFC8727	XXX21224	

**Batch Information**

Analytical Batch: XFC8727

Analytical Method: SW8015C

Analysis Date/Time: 07/30/09 02:52

Dilution Factor: 1

Prep Batch: XXX21224

Prep Method: SW3520C

Prep Date/Time: 07/21/09 10:15

Initial Prep Wt./Vol.: 950 mL

Prep Extract Vol.: 1 mL

Container ID:1093515004-H

Analyst: KDC

Client Sample ID: **RHMW05-WG16**

SGS Ref. #: 1093515004

Project ID: Red Hill BFSF

Matrix: Water (Surface, Eff., Ground)

Collection Date/Time: 07/15/09 07:35

Receipt Date/Time: 07/17/09 11:00

**Volatile Gas Chromatography/Mass Spectroscopy**

<u>Parameter</u>	<u>Result</u>	<u>PQL/CL</u>	<u>MDL</u>	<u>Units</u>	<u>DF</u>	<u>Analytical</u> <u>Batch</u>	<u>Prep</u> <u>Batch</u>	<u>Qualifiers</u>
Benzene	ND	0.400	0.120	ug/L	1	VMS10654	VXX19686	
Toluene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Ethylbenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
n-Butylbenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,4-Dichlorobenzene	ND	0.500	0.150	ug/L	1	VMS10654	VXX19686	
1,2-Dichloroethane	ND	0.500	0.150	ug/L	1	VMS10654	VXX19686	
1,3,5-Trimethylbenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
4-Chlorotoluene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Chlorobenzene	ND	0.500	0.150	ug/L	1	VMS10654	VXX19686	
4-Methyl-2-pentanone (MIBK)	ND	10.0	3.10	ug/L	1	VMS10654	VXX19686	
cis-1,2-Dichloroethene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
4-Isopropyltoluene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
cis-1,3-Dichloropropene	ND	0.500	0.150	ug/L	1	VMS10654	VXX19686	
n-Propylbenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Styrene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Dibromomethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
trans-1,3-Dichloropropene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,2,4-Trichlorobenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Acetone	65.0	10.0	3.10	ug/L	1	VMS10654	VXX19686	
1,1,2,2-Tetrachloroethane	ND	0.500	0.150	ug/L	1	VMS10654	VXX19686	
1,2-Dibromo-3-chloropropane	ND	2.00	0.620	ug/L	1	VMS10654	VXX19686	
Methyl-t-butyl ether	ND	5.00	1.50	ug/L	1	VMS10654	VXX19686	
Tetrachloroethene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Dibromochloromethane	ND	0.500	0.150	ug/L	1	VMS10654	VXX19686	
1,3-Dichloropropane	ND	0.400	0.120	ug/L	1	VMS10654	VXX19686	
1,2-Dibromoethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Carbon tetrachloride	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,1,1,2-Tetrachloroethane	ND	0.500	0.150	ug/L	1	VMS10654	VXX19686	
Chloroform	ND	1.00	0.300	ug/L	1	VMS10654	VXX19686	
Bromobenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Chloromethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,2,3-Trichloropropane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Bromomethane	ND	3.00	0.940	ug/L	1	VMS10654	VXX19686	
Bromochloromethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Vinyl chloride	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Dichlorodifluoromethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	



Client Sample ID: **RHMW05-WG16**

SGS Ref. #: 1093515004

Project ID: Red Hill BFSF

Matrix: Water (Surface, Eff., Ground)

Collection Date/Time: 07/15/09 07:35

Receipt Date/Time: 07/17/09 11:00

**Volatile Gas Chromatography/Mass Spectroscopy**

<u>Parameter</u>	<u>Result</u>	<u>PQL/CL</u>	<u>MDL</u>	<u>Units</u>	<u>DF</u>	<u>Analytical Batch</u>	<u>Prep Batch</u>	<u>Qualifiers</u>
Chloroethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
sec-Butylbenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Bromodichloromethane	ND	0.500	0.150	ug/L	1	VMS10654	VXX19686	
1,1-Dichloroethene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
2-Butanone (MEK)	ND	10.0	3.10	ug/L	1	VMS10654	VXX19686	
Methylene chloride	ND	5.00	1.00	ug/L	1	VMS10654	VXX19686	
Trichlorofluoromethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
P & M -Xylene	ND	2.00	0.620	ug/L	1	VMS10654	VXX19686	
Naphthalene	ND	2.00	0.620	ug/L	1	VMS10654	VXX19686	
o-Xylene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Bromoform	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1-Chlorohexane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,2,4-Trimethylbenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
tert-Butylbenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,1,1-Trichloroethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,1-Dichloroethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
2-Chlorotoluene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Trichloroethene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
trans-1,2-Dichloroethene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,2-Dichlorobenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
2,2-Dichloropropane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Hexachlorobutadiene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Isopropylbenzene (Cumene)	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,2-Dichloropropane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,1-Dichloropropene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,1,2-Trichloroethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,3-Dichlorobenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,2,3-Trichlorobenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,2-Dichloroethane-D4 <surr>	113	73-120		%	1	VMS10654	VXX19686	
Toluene-d8 <surr>	99.9	80-120		%	1	VMS10654	VXX19686	
4-Bromofluorobenzene <surr>	106	76-120		%	1	VMS10654	VXX19686	

**Batch Information**

Analytical Batch: VMS10654  
Analytical Method: SW8260B  
Analysis Date/Time: 07/20/09 20:36  
Dilution Factor: 1

Prep Batch: VXX19686  
Prep Method: SW5030B  
Prep Date/Time: 07/20/09 12:19

Initial Prep Wt./Vol.: 5 mL  
Prep Extract Vol.: 5 mL  
Container ID:1093515004-D  
Analyst: DSH



Client Sample ID: **RHMW05-WG16**  
SGS Ref. #: 1093515004  
Project ID: Red Hill BFSF  
Matrix: Water (Surface, Eff., Ground)

Collection Date/Time: 07/15/09 07:35  
Receipt Date/Time: 07/17/09 11:00

**Polynuclear Aromatics GC/MS**

<u>Parameter</u>	<u>Result</u>	<u>PQL/CL</u>	<u>MDL</u>	<u>Units</u>	<u>DF</u>	<u>Analytical Batch</u>	<u>Prep Batch</u>	<u>Qualifiers</u>
Acenaphthylene	ND	0.0549	0.0165	ug/L	1	XMS4994	XXX21226	
Acenaphthene	ND	0.0549	0.0165	ug/L	1	XMS4994	XXX21226	
Fluorene	ND	0.0549	0.0165	ug/L	1	XMS4994	XXX21226	
Phenanthrene	ND	0.0549	0.0165	ug/L	1	XMS4994	XXX21226	
Anthracene	ND	0.0549	0.0165	ug/L	1	XMS4994	XXX21226	
Fluoranthene	ND	0.0549	0.0165	ug/L	1	XMS4994	XXX21226	
Pyrene	ND	0.0549	0.0165	ug/L	1	XMS4994	XXX21226	
Benzo(a)Anthracene	ND	0.0549	0.0165	ug/L	1	XMS4994	XXX21226	
Chrysene	ND	0.0549	0.0165	ug/L	1	XMS4994	XXX21226	
Benzo[b]Fluoranthene	ND	0.0549	0.0165	ug/L	1	XMS4994	XXX21226	
Benzo[k]fluoranthene	ND	0.0549	0.0165	ug/L	1	XMS4994	XXX21226	
Benzo[a]pyrene	ND	0.0549	0.0165	ug/L	1	XMS4994	XXX21226	
Indeno[1,2,3-c,d] pyrene	ND	0.0549	0.0165	ug/L	1	XMS4994	XXX21226	
Dibenzo[a,h]anthracene	ND	0.0549	0.0165	ug/L	1	XMS4994	XXX21226	
Benzo[g,h,i]perylene	ND	0.0549	0.0165	ug/L	1	XMS4994	XXX21226	
Naphthalene	ND	0.110	0.0341	ug/L	1	XMS4994	XXX21226	
1-Methylnaphthalene	ND	0.0549	0.0165	ug/L	1	XMS4994	XXX21226	
2-Methylnaphthalene	ND	0.0549	0.0165	ug/L	1	XMS4994	XXX21226	
Terphenyl-d14 <surr>	83.7	50-135		%	1	XMS4994	XXX21226	

**Batch Information**

Analytical Batch: XMS4994  
Analytical Method: 8270D SIMS  
Analysis Date/Time: 07/22/09 09:02  
Dilution Factor: 1

Prep Batch: XXX21226  
Prep Method: SW3520C  
Prep Date/Time: 07/21/09 10:40

Initial Prep Wt./Vol.: 910 mL  
Prep Extract Vol.: 1 mL  
Container ID:1093515004-J  
Analyst: JDH



Client Sample ID: **RHMW01-WG16**  
SGS Ref. #: 1093515005  
Project ID: Red Hill BFSF  
Matrix: Water (Surface, Eff., Ground)

Collection Date/Time: 07/15/09 15:15  
Receipt Date/Time: 07/17/09 11:00

**Dissolved Metals by ICP/MS**

<u>Parameter</u>	<u>Result</u>	<u>PQL/CL</u>	<u>MDL</u>	<u>Units</u>	<u>DF</u>	<u>Analytical Batch</u>	<u>Prep Batch</u>	<u>Qualifiers</u>
Lead	ND	1.00	0.310	ug/L	5	MMS5997	MXX21958	

**Batch Information**

Analytical Batch: MMS5997  
Analytical Method: SW6020  
Analysis Date/Time: 07/28/09 14:09  
Dilution Factor: 5

Prep Batch: MXX21958  
Prep Method: SW3010A  
Prep Date/Time: 07/27/09 19:20

Initial Prep Wt./Vol.: 50 mL  
Prep Extract Vol.: 50 mL  
Container ID:1093515005-G  
Analyst: NRB



The Environmental Company, Inc. (TEC)

Print Date: 8/3/2009 4:39 pm

Client Sample ID: **RHMW01-WG16**  
SGS Ref. #: 1093515005  
Project ID: Red Hill BFSF  
Matrix: Water (Surface, Eff., Ground)

Collection Date/Time: 07/15/09 15:15  
Receipt Date/Time: 07/17/09 11:00

**Volatile Fuels Department**

<u>Parameter</u>	<u>Result</u>	<u>PQL/CL</u>	<u>MDL</u>	<u>Units</u>	<u>DF</u>	<u>Analytical Batch</u>	<u>Prep Batch</u>	<u>Qualifiers</u>
Gasoline Range Organics	ND	100	30.0	ug/L	1	VFC9556	VXX19707	
4-Bromofluorobenzene <sur>	95.8	50-150		%	1	VFC9556	VXX19707	

**Batch Information**

Analytical Batch: VFC9556  
Analytical Method: SW8015C  
Analysis Date/Time: 07/23/09 11:09  
Dilution Factor: 1

Prep Batch: VXX19707  
Prep Method: SW5030B  
Prep Date/Time: 07/23/09 08:25

Initial Prep Wt./Vol.: 5 mL  
Prep Extract Vol.: 5 mL  
Container ID:1093515005-A  
Analyst: KPW



Client Sample ID: **RHMW01-WG16**  
SGS Ref. #: 1093515005  
Project ID: Red Hill BFSF  
Matrix: Water (Surface, Eff., Ground)

Collection Date/Time: 07/15/09 15:15  
Receipt Date/Time: 07/17/09 11:00

**Semivolatile Organic Fuels Department**

<u>Parameter</u>	<u>Result</u>	<u>PQL/CL</u>	<u>MDL</u>	<u>Units</u>	<u>DF</u>	<u>Analytical Batch</u>	<u>Prep Batch</u>	<u>Qualifiers</u>
Diesel Range Organics	0.248 J	0.430	0.161	mg/L	1	XFC8727	XXX21224	
5a Androstane <sur>	82.6	50-150		%	1	XFC8727	XXX21224	

**Batch Information**

Analytical Batch: XFC8727  
Analytical Method: SW8015C  
Analysis Date/Time: 07/30/09 03:20  
Dilution Factor: 1

Prep Batch: XXX21224  
Prep Method: SW3520C  
Prep Date/Time: 07/21/09 10:15

Initial Prep Wt./Vol.: 930 mL  
Prep Extract Vol.: 1 mL  
Container ID:1093515005-H  
Analyst: KDC



Client Sample ID: **RHMW01-WG16**

SGS Ref. #: 1093515005

Project ID: Red Hill BFSF

Matrix: Water (Surface, Eff., Ground)

Collection Date/Time: 07/15/09 15:15

Receipt Date/Time: 07/17/09 11:00

**Volatile Gas Chromatography/Mass Spectroscopy**

<u>Parameter</u>	<u>Result</u>	<u>PQL/CL</u>	<u>MDL</u>	<u>Units</u>	<u>DF</u>	<u>Analytical</u> <u>Batch</u>	<u>Prep</u> <u>Batch</u>	<u>Qualifiers</u>
Benzene	ND	0.400	0.120	ug/L	1	VMS10654	VXX19686	
Toluene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Ethylbenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
n-Butylbenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,4-Dichlorobenzene	ND	0.500	0.150	ug/L	1	VMS10654	VXX19686	
1,2-Dichloroethane	ND	0.500	0.150	ug/L	1	VMS10654	VXX19686	
1,3,5-Trimethylbenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
4-Chlorotoluene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Chlorobenzene	ND	0.500	0.150	ug/L	1	VMS10654	VXX19686	
4-Methyl-2-pentanone (MIBK)	ND	10.0	3.10	ug/L	1	VMS10654	VXX19686	
cis-1,2-Dichloroethene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
4-Isopropyltoluene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
cis-1,3-Dichloropropene	ND	0.500	0.150	ug/L	1	VMS10654	VXX19686	
n-Propylbenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Styrene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Dibromomethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
trans-1,3-Dichloropropene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,2,4-Trichlorobenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Acetone	ND	10.0	3.10	ug/L	1	VMS10654	VXX19686	
1,1,2,2-Tetrachloroethane	ND	0.500	0.150	ug/L	1	VMS10654	VXX19686	
1,2-Dibromo-3-chloropropane	ND	2.00	0.620	ug/L	1	VMS10654	VXX19686	
Methyl-t-butyl ether	ND	5.00	1.50	ug/L	1	VMS10654	VXX19686	
Tetrachloroethene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Dibromochloromethane	ND	0.500	0.150	ug/L	1	VMS10654	VXX19686	
1,3-Dichloropropane	ND	0.400	0.120	ug/L	1	VMS10654	VXX19686	
1,2-Dibromoethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Carbon tetrachloride	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,1,1,2-Tetrachloroethane	ND	0.500	0.150	ug/L	1	VMS10654	VXX19686	
Chloroform	ND	1.00	0.300	ug/L	1	VMS10654	VXX19686	
Bromobenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Chloromethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,2,3-Trichloropropane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Bromomethane	ND	3.00	0.940	ug/L	1	VMS10654	VXX19686	
Bromochloromethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Vinyl chloride	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Dichlorodifluoromethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	



Client Sample ID: **RHMW01-WG16**

SGS Ref. #: 1093515005

Project ID: Red Hill BFSF

Matrix: Water (Surface, Eff., Ground)

Collection Date/Time: 07/15/09 15:15

Receipt Date/Time: 07/17/09 11:00

**Volatile Gas Chromatography/Mass Spectroscopy**

<u>Parameter</u>	<u>Result</u>	<u>PQL/CL</u>	<u>MDL</u>	<u>Units</u>	<u>DF</u>	<u>Analytical Batch</u>	<u>Prep Batch</u>	<u>Qualifiers</u>
Chloroethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
sec-Butylbenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Bromodichloromethane	ND	0.500	0.150	ug/L	1	VMS10654	VXX19686	
1,1-Dichloroethene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
2-Butanone (MEK)	ND	10.0	3.10	ug/L	1	VMS10654	VXX19686	
Methylene chloride	ND	5.00	1.00	ug/L	1	VMS10654	VXX19686	
Trichlorofluoromethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
P & M -Xylene	ND	2.00	0.620	ug/L	1	VMS10654	VXX19686	
Naphthalene	ND	2.00	0.620	ug/L	1	VMS10654	VXX19686	
o-Xylene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Bromoform	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1-Chlorohexane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,2,4-Trimethylbenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
tert-Butylbenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,1,1-Trichloroethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,1-Dichloroethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
2-Chlorotoluene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Trichloroethene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
trans-1,2-Dichloroethene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,2-Dichlorobenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
2,2-Dichloropropane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Hexachlorobutadiene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Isopropylbenzene (Cumene)	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,2-Dichloropropane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,1-Dichloropropene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,1,2-Trichloroethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,3-Dichlorobenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,2,3-Trichlorobenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,2-Dichloroethane-D4 <surr>	111	73-120		%	1	VMS10654	VXX19686	
Toluene-d8 <surr>	98.9	80-120		%	1	VMS10654	VXX19686	
4-Bromofluorobenzene <surr>	106	76-120		%	1	VMS10654	VXX19686	

**Batch Information**

Analytical Batch: VMS10654  
Analytical Method: SW8260B  
Analysis Date/Time: 07/20/09 21:07  
Dilution Factor: 1

Prep Batch: VXX19686  
Prep Method: SW5030B  
Prep Date/Time: 07/20/09 12:19

Initial Prep Wt./Vol.: 5 mL  
Prep Extract Vol.: 5 mL  
Container ID: 1093515005-D  
Analyst: DSH



Client Sample ID: **RHMW01-WG16**  
SGS Ref. #: 1093515005  
Project ID: Red Hill BFSF  
Matrix: Water (Surface, Eff., Ground)

Collection Date/Time: 07/15/09 15:15  
Receipt Date/Time: 07/17/09 11:00

**Polynuclear Aromatics GC/MS**

<u>Parameter</u>	<u>Result</u>	<u>PQL/CL</u>	<u>MDL</u>	<u>Units</u>	<u>DF</u>	<u>Analytical Batch</u>	<u>Prep Batch</u>	<u>Qualifiers</u>
Acenaphthylene	ND	0.0526	0.0158	ug/L	1	XMS4994	XXX21226	
Acenaphthene	0.180	0.0526	0.0158	ug/L	1	XMS4994	XXX21226	
Fluorene	0.0952	0.0526	0.0158	ug/L	1	XMS4994	XXX21226	
Phenanthrene	0.0349 J	0.0526	0.0158	ug/L	1	XMS4994	XXX21226	
Anthracene	ND	0.0526	0.0158	ug/L	1	XMS4994	XXX21226	
Fluoranthene	0.0263 J	0.0526	0.0158	ug/L	1	XMS4994	XXX21226	
Pyrene	0.0270 J	0.0526	0.0158	ug/L	1	XMS4994	XXX21226	
Benzo(a)Anthracene	ND	0.0526	0.0158	ug/L	1	XMS4994	XXX21226	
Chrysene	0.0159 J	0.0526	0.0158	ug/L	1	XMS4994	XXX21226	
Benzo[b]Fluoranthene	ND	0.0526	0.0158	ug/L	1	XMS4994	XXX21226	
Benzo[k]fluoranthene	ND	0.0526	0.0158	ug/L	1	XMS4994	XXX21226	
Benzo[a]pyrene	ND	0.0526	0.0158	ug/L	1	XMS4994	XXX21226	
Indeno[1,2,3-c,d] pyrene	ND	0.0526	0.0158	ug/L	1	XMS4994	XXX21226	
Dibenzo[a,h]anthracene	ND	0.0526	0.0158	ug/L	1	XMS4994	XXX21226	
Benzo[g,h,i]perylene	ND	0.0526	0.0158	ug/L	1	XMS4994	XXX21226	
Naphthalene	5.61	1.05	0.326	ug/L	10	XMS4996	XXX21226	
1-Methylnaphthalene	9.44	0.526	0.158	ug/L	10	XMS4996	XXX21226	
2-Methylnaphthalene	3.07	0.526	0.158	ug/L	10	XMS4996	XXX21226	
Terphenyl-d14 <sur>	84.1	50-135		%	1	XMS4994	XXX21226	

**Batch Information**

Analytical Batch: XMS4994  
Analytical Method: 8270D SIMS  
Analysis Date/Time: 07/22/09 09:36  
Dilution Factor: 1

Prep Batch: XXX21226  
Prep Method: SW3520C  
Prep Date/Time: 07/21/09 10:40

Initial Prep Wt./Vol.: 950 mL  
Prep Extract Vol.: 1 mL  
Container ID:1093515005-J  
Analyst: JDH

Analytical Batch: XMS4996  
Analytical Method: 8270D SIMS  
Analysis Date/Time: 07/22/09 18:29  
Dilution Factor: 10

Prep Batch: XXX21226  
Prep Method: SW3520C  
Prep Date/Time: 07/21/09 10:40

Initial Prep Wt./Vol.: 950 mL  
Prep Extract Vol.: 1 mL  
Container ID:1093515005-J  
Analyst: JDH



Client Sample ID: **RHMW03-WG16**  
SGS Ref. #: 1093515006  
Project ID: Red Hill BFSF  
Matrix: Water (Surface, Eff., Ground)

Collection Date/Time: 07/15/09 10:55  
Receipt Date/Time: 07/17/09 11:00

**Dissolved Metals by ICP/MS**

<u>Parameter</u>	<u>Result</u>	<u>PQL/CL</u>	<u>MDL</u>	<u>Units</u>	<u>DF</u>	<u>Analytical</u> <u>Batch</u>	<u>Prep</u> <u>Batch</u>	<u>Qualifiers</u>
Lead	ND	1.00	0.310	ug/L	5	MMS5997	MXX21958	

**Batch Information**

Analytical Batch: MMS5997  
Analytical Method: SW6020  
Analysis Date/Time: 07/28/09 14:11  
Dilution Factor: 5

Prep Batch: MXX21958  
Prep Method: SW3010A  
Prep Date/Time: 07/27/09 19:20

Initial Prep Wt./Vol.: 50 mL  
Prep Extract Vol.: 50 mL  
Container ID:1093515006-G  
Analyst: NRB



The Environmental Company, Inc. (TEC)

Print Date: 8/3/2009 4:39 pm

Client Sample ID: **RHMW03-WG16**  
SGS Ref. #: 1093515006  
Project ID: Red Hill BFSF  
Matrix: Water (Surface, Eff., Ground)

Collection Date/Time: 07/15/09 10:55  
Receipt Date/Time: 07/17/09 11:00

**Volatile Fuels Department**

<u>Parameter</u>	<u>Result</u>	<u>PQL/CL</u>	<u>MDL</u>	<u>Units</u>	<u>DF</u>	<u>Analytical Batch</u>	<u>Prep Batch</u>	<u>Qualifiers</u>
Gasoline Range Organics	ND	100	30.0	ug/L	1	VFC9556	VXX19707	
4-Bromofluorobenzene <sur>	97.2	50-150		%	1	VFC9556	VXX19707	

**Batch Information**

Analytical Batch: VFC9556  
Analytical Method: SW8015C  
Analysis Date/Time: 07/23/09 11:27  
Dilution Factor: 1

Prep Batch: VXX19707  
Prep Method: SW5030B  
Prep Date/Time: 07/23/09 08:25

Initial Prep Wt./Vol.: 5 mL  
Prep Extract Vol.: 5 mL  
Container ID:1093515006-A  
Analyst: KPW



Client Sample ID: **RHMW03-WG16**  
SGS Ref. #: 1093515006  
Project ID: Red Hill BFSF  
Matrix: Water (Surface, Eff., Ground)

Collection Date/Time: 07/15/09 10:55  
Receipt Date/Time: 07/17/09 11:00

**Semivolatile Organic Fuels Department**

<u>Parameter</u>	<u>Result</u>	<u>PQL/CL</u>	<u>MDL</u>	<u>Units</u>	<u>DF</u>	<u>Analytical Batch</u>	<u>Prep Batch</u>	<u>Qualifiers</u>
Diesel Range Organics	ND	0.400	0.150	mg/L	1	XFC8727	XXX21224	
5a Androstane <sur>	88.3	50-150		%	1	XFC8727	XXX21224	

**Batch Information**

Analytical Batch: XFC8727  
Analytical Method: SW8015C  
Analysis Date/Time: 07/30/09 03:30  
Dilution Factor: 1

Prep Batch: XXX21224  
Prep Method: SW3520C  
Prep Date/Time: 07/21/09 10:15

Initial Prep Wt./Vol.: 1000 mL  
Prep Extract Vol.: 1 mL  
Container ID:1093515006-H  
Analyst: KDC

Client Sample ID: **RHMW03-WG16**

SGS Ref. #: 1093515006

Project ID: Red Hill BFSF

Matrix: Water (Surface, Eff., Ground)

Collection Date/Time: 07/15/09 10:55

Receipt Date/Time: 07/17/09 11:00

**Volatile Gas Chromatography/Mass Spectroscopy**

<u>Parameter</u>	<u>Result</u>	<u>PQL/CL</u>	<u>MDL</u>	<u>Units</u>	<u>DF</u>	<u>Analytical</u> <u>Batch</u>	<u>Prep</u> <u>Batch</u>	<u>Qualifiers</u>
Benzene	ND	0.400	0.120	ug/L	1	VMS10654	VXX19686	
Toluene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Ethylbenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
n-Butylbenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,4-Dichlorobenzene	ND	0.500	0.150	ug/L	1	VMS10654	VXX19686	
1,2-Dichloroethane	ND	0.500	0.150	ug/L	1	VMS10654	VXX19686	
1,3,5-Trimethylbenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
4-Chlorotoluene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Chlorobenzene	ND	0.500	0.150	ug/L	1	VMS10654	VXX19686	
4-Methyl-2-pentanone (MIBK)	ND	10.0	3.10	ug/L	1	VMS10654	VXX19686	
cis-1,2-Dichloroethene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
4-Isopropyltoluene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
cis-1,3-Dichloropropene	ND	0.500	0.150	ug/L	1	VMS10654	VXX19686	
n-Propylbenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Styrene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Dibromomethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
trans-1,3-Dichloropropene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,2,4-Trichlorobenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Acetone	ND	10.0	3.10	ug/L	1	VMS10654	VXX19686	
1,1,2,2-Tetrachloroethane	ND	0.500	0.150	ug/L	1	VMS10654	VXX19686	
1,2-Dibromo-3-chloropropane	ND	2.00	0.620	ug/L	1	VMS10654	VXX19686	
Methyl-t-butyl ether	ND	5.00	1.50	ug/L	1	VMS10654	VXX19686	
Tetrachloroethene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Dibromochloromethane	ND	0.500	0.150	ug/L	1	VMS10654	VXX19686	
1,3-Dichloropropane	ND	0.400	0.120	ug/L	1	VMS10654	VXX19686	
1,2-Dibromoethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Carbon tetrachloride	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,1,1,2-Tetrachloroethane	ND	0.500	0.150	ug/L	1	VMS10654	VXX19686	
Chloroform	ND	1.00	0.300	ug/L	1	VMS10654	VXX19686	
Bromobenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Chloromethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,2,3-Trichloropropane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Bromomethane	ND	3.00	0.940	ug/L	1	VMS10654	VXX19686	
Bromochloromethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Vinyl chloride	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Dichlorodifluoromethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	



Client Sample ID: **RHMW03-WG16**

SGS Ref. #: 1093515006

Project ID: Red Hill BFSF

Matrix: Water (Surface, Eff., Ground)

Collection Date/Time: 07/15/09 10:55

Receipt Date/Time: 07/17/09 11:00

**Volatile Gas Chromatography/Mass Spectroscopy**

<u>Parameter</u>	<u>Result</u>	<u>PQL/CL</u>	<u>MDL</u>	<u>Units</u>	<u>DF</u>	<u>Analytical Batch</u>	<u>Prep Batch</u>	<u>Qualifiers</u>
Chloroethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
sec-Butylbenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Bromodichloromethane	ND	0.500	0.150	ug/L	1	VMS10654	VXX19686	
1,1-Dichloroethene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
2-Butanone (MEK)	ND	10.0	3.10	ug/L	1	VMS10654	VXX19686	
Methylene chloride	ND	5.00	1.00	ug/L	1	VMS10654	VXX19686	
Trichlorofluoromethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
P & M -Xylene	ND	2.00	0.620	ug/L	1	VMS10654	VXX19686	
Naphthalene	ND	2.00	0.620	ug/L	1	VMS10654	VXX19686	
o-Xylene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Bromoform	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1-Chlorohexane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,2,4-Trimethylbenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
tert-Butylbenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,1,1-Trichloroethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,1-Dichloroethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
2-Chlorotoluene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Trichloroethene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
trans-1,2-Dichloroethene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,2-Dichlorobenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
2,2-Dichloropropane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Hexachlorobutadiene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Isopropylbenzene (Cumene)	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,2-Dichloropropane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,1-Dichloropropene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,1,2-Trichloroethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,3-Dichlorobenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,2,3-Trichlorobenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,2-Dichloroethane-D4 <surr>	115	73-120		%	1	VMS10654	VXX19686	
Toluene-d8 <surr>	99.9	80-120		%	1	VMS10654	VXX19686	
4-Bromofluorobenzene <surr>	106	76-120		%	1	VMS10654	VXX19686	

**Batch Information**

Analytical Batch: VMS10654  
Analytical Method: SW8260B  
Analysis Date/Time: 07/20/09 21:38  
Dilution Factor: 1

Prep Batch: VXX19686  
Prep Method: SW5030B  
Prep Date/Time: 07/20/09 12:19

Initial Prep Wt./Vol.: 5 mL  
Prep Extract Vol.: 5 mL  
Container ID:1093515006-D  
Analyst: DSH





Client Sample ID: **RHMW03-WG16**  
SGS Ref. #: 1093515006  
Project ID: Red Hill BFSF  
Matrix: Water (Surface, Eff., Ground)

Collection Date/Time: 07/15/09 10:55  
Receipt Date/Time: 07/17/09 11:00

**Polynuclear Aromatics GC/MS**

<u>Parameter</u>	<u>Result</u>	<u>PQL/CL</u>	<u>MDL</u>	<u>Units</u>	<u>DF</u>	<u>Analytical Batch</u>	<u>Prep Batch</u>	<u>Qualifiers</u>
Acenaphthylene	ND	0.0526	0.0158	ug/L	1	XMS4994	XXX21226	
Acenaphthene	ND	0.0526	0.0158	ug/L	1	XMS4994	XXX21226	
Fluorene	ND	0.0526	0.0158	ug/L	1	XMS4994	XXX21226	
Phenanthrene	ND	0.0526	0.0158	ug/L	1	XMS4994	XXX21226	
Anthracene	ND	0.0526	0.0158	ug/L	1	XMS4994	XXX21226	
Fluoranthene	ND	0.0526	0.0158	ug/L	1	XMS4994	XXX21226	
Pyrene	ND	0.0526	0.0158	ug/L	1	XMS4994	XXX21226	
Benzo(a)Anthracene	ND	0.0526	0.0158	ug/L	1	XMS4994	XXX21226	
Chrysene	ND	0.0526	0.0158	ug/L	1	XMS4994	XXX21226	
Benzo[b]Fluoranthene	ND	0.0526	0.0158	ug/L	1	XMS4994	XXX21226	
Benzo[k]fluoranthene	ND	0.0526	0.0158	ug/L	1	XMS4994	XXX21226	
Benzo[a]pyrene	ND	0.0526	0.0158	ug/L	1	XMS4994	XXX21226	
Indeno[1,2,3-c,d] pyrene	ND	0.0526	0.0158	ug/L	1	XMS4994	XXX21226	
Dibenzo[a,h]anthracene	ND	0.0526	0.0158	ug/L	1	XMS4994	XXX21226	
Benzo[g,h,i]perylene	ND	0.0526	0.0158	ug/L	1	XMS4994	XXX21226	
Naphthalene	ND	0.105	0.0326	ug/L	1	XMS4994	XXX21226	
1-Methylnaphthalene	ND	0.0526	0.0158	ug/L	1	XMS4994	XXX21226	
2-Methylnaphthalene	ND	0.0526	0.0158	ug/L	1	XMS4994	XXX21226	
Terphenyl-d14 <sur>	97.1	50-135		%	1	XMS4994	XXX21226	

**Batch Information**

Analytical Batch: XMS4994  
Analytical Method: 8270D SIMS  
Analysis Date/Time: 07/22/09 10:09  
Dilution Factor: 1

Prep Batch: XXX21226  
Prep Method: SW3520C  
Prep Date/Time: 07/21/09 10:40

Initial Prep Wt./Vol.: 950 mL  
Prep Extract Vol.: 1 mL  
Container ID:1093515006-J  
Analyst: JDH



The Environmental Company, Inc. (TEC)

Print Date: 8/3/2009 4:39 pm

Client Sample ID: **RHMW02-WG16**  
SGS Ref. #: 1093515007  
Project ID: Red Hill BFSF  
Matrix: Water (Surface, Eff., Ground)

Collection Date/Time: 07/15/09 13:20  
Receipt Date/Time: 07/17/09 11:00

**Dissolved Metals by ICP/MS**

<u>Parameter</u>	<u>Result</u>	<u>PQL/CL</u>	<u>MDL</u>	<u>Units</u>	<u>DF</u>	<u>Analytical</u> <u>Batch</u>	<u>Prep</u> <u>Batch</u>	<u>Qualifiers</u>
Lead	ND	1.00	0.310	ug/L	5	MMS5997	MXX21958	

**Batch Information**

Analytical Batch: MMS5997  
Analytical Method: SW6020  
Analysis Date/Time: 07/28/09 14:13  
Dilution Factor: 5

Prep Batch: MXX21958  
Prep Method: SW3010A  
Prep Date/Time: 07/27/09 19:20

Initial Prep Wt./Vol.: 50 mL  
Prep Extract Vol.: 50 mL  
Container ID:1093515007-G  
Analyst: NRB



The Environmental Company, Inc. (TEC)

Print Date: 8/3/2009 4:39 pm

Client Sample ID: **RHMW02-WG16**  
SGS Ref. #: 1093515007  
Project ID: Red Hill BFSF  
Matrix: Water (Surface, Eff., Ground)

Collection Date/Time: 07/15/09 13:20  
Receipt Date/Time: 07/17/09 11:00

**Volatile Fuels Department**

<u>Parameter</u>	<u>Result</u>	<u>PQL/CL</u>	<u>MDL</u>	<u>Units</u>	<u>DF</u>	<u>Analytical Batch</u>	<u>Prep Batch</u>	<u>Qualifiers</u>
Gasoline Range Organics	ND	100	30.0	ug/L	1	VFC9556	VXX19707	
4-Bromofluorobenzene <sur>	96.8	50-150		%	1	VFC9556	VXX19707	

**Batch Information**

Analytical Batch: VFC9556  
Analytical Method: SW8015C  
Analysis Date/Time: 07/23/09 11:46  
Dilution Factor: 1

Prep Batch: VXX19707  
Prep Method: SW5030B  
Prep Date/Time: 07/23/09 08:25

Initial Prep Wt./Vol.: 5 mL  
Prep Extract Vol.: 5 mL  
Container ID:1093515007-A  
Analyst: KPW



The Environmental Company, Inc. (TEC)

Print Date: 8/3/2009 4:39 pm

Client Sample ID: **RHMW02-WG16**

SGS Ref. #: 1093515007

Project ID: Red Hill BFSF

Matrix: Water (Surface, Eff., Ground)

Collection Date/Time: 07/15/09 13:20

Receipt Date/Time: 07/17/09 11:00

**Semivolatile Organic Fuels Department**

<u>Parameter</u>	<u>Result</u>	<u>PQL/CL</u>	<u>MDL</u>	<u>Units</u>	<u>DF</u>	<u>Analytical</u> <u>Batch</u>	<u>Prep</u> <u>Batch</u>	<u>Qualifiers</u>
Diesel Range Organics	1.45	0.400	0.150	mg/L	1	XFC8727	XXX21224	
5a Androstane <sur>	78.9	50-150		%	1	XFC8727	XXX21224	

**Batch Information**

Analytical Batch: XFC8727

Analytical Method: SW8015C

Analysis Date/Time: 07/30/09 03:39

Dilution Factor: 1

Prep Batch: XXX21224

Prep Method: SW3520C

Prep Date/Time: 07/21/09 10:15

Initial Prep Wt./Vol.: 1000 mL

Prep Extract Vol.: 1 mL

Container ID:1093515007-H

Analyst: KDC

Client Sample ID: **RHMW02-WG16**

SGS Ref. #: 1093515007

Project ID: Red Hill BFSF

Matrix: Water (Surface, Eff., Ground)

Collection Date/Time: 07/15/09 13:20

Receipt Date/Time: 07/17/09 11:00

**Volatile Gas Chromatography/Mass Spectroscopy**

<u>Parameter</u>	<u>Result</u>	<u>PQL/CL</u>	<u>MDL</u>	<u>Units</u>	<u>DF</u>	<u>Analytical</u> <u>Batch</u>	<u>Prep</u> <u>Batch</u>	<u>Qualifiers</u>
Benzene	ND	0.400	0.120	ug/L	1	VMS10654	VXX19686	
Toluene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Ethylbenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
n-Butylbenzene	1.51	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,4-Dichlorobenzene	ND	0.500	0.150	ug/L	1	VMS10654	VXX19686	
1,2-Dichloroethane	ND	0.500	0.150	ug/L	1	VMS10654	VXX19686	
1,3,5-Trimethylbenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
4-Chlorotoluene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Chlorobenzene	ND	0.500	0.150	ug/L	1	VMS10654	VXX19686	
4-Methyl-2-pentanone (MIBK)	ND	10.0	3.10	ug/L	1	VMS10654	VXX19686	
cis-1,2-Dichloroethene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
4-Isopropyltoluene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
cis-1,3-Dichloropropene	ND	0.500	0.150	ug/L	1	VMS10654	VXX19686	
n-Propylbenzene	2.49	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Styrene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Dibromomethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
trans-1,3-Dichloropropene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,2,4-Trichlorobenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Acetone	ND	10.0	3.10	ug/L	1	VMS10654	VXX19686	
1,1,2,2-Tetrachloroethane	ND	0.500	0.150	ug/L	1	VMS10654	VXX19686	
1,2-Dibromo-3-chloropropane	ND	2.00	0.620	ug/L	1	VMS10654	VXX19686	
Methyl-t-butyl ether	ND	5.00	1.50	ug/L	1	VMS10654	VXX19686	
Tetrachloroethene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Dibromochloromethane	ND	0.500	0.150	ug/L	1	VMS10654	VXX19686	
1,3-Dichloropropane	ND	0.400	0.120	ug/L	1	VMS10654	VXX19686	
1,2-Dibromoethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Carbon tetrachloride	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,1,1,2-Tetrachloroethane	ND	0.500	0.150	ug/L	1	VMS10654	VXX19686	
Chloroform	ND	1.00	0.300	ug/L	1	VMS10654	VXX19686	
Bromobenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Chloromethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,2,3-Trichloropropane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Bromomethane	ND	3.00	0.940	ug/L	1	VMS10654	VXX19686	
Bromochloromethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Vinyl chloride	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Dichlorodifluoromethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	



Client Sample ID: **RHMW02-WG16**

SGS Ref. #: 1093515007

Project ID: Red Hill BFSF

Matrix: Water (Surface, Eff., Ground)

Collection Date/Time: 07/15/09 13:20

Receipt Date/Time: 07/17/09 11:00

**Volatile Gas Chromatography/Mass Spectroscopy**

<u>Parameter</u>	<u>Result</u>	<u>PQL/CL</u>	<u>MDL</u>	<u>Units</u>	<u>DF</u>	<u>Analytical Batch</u>	<u>Prep Batch</u>	<u>Qualifiers</u>
Chloroethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
sec-Butylbenzene	3.48	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Bromodichloromethane	ND	0.500	0.150	ug/L	1	VMS10654	VXX19686	
1,1-Dichloroethene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
2-Butanone (MEK)	ND	10.0	3.10	ug/L	1	VMS10654	VXX19686	
Methylene chloride	ND	5.00	1.00	ug/L	1	VMS10654	VXX19686	
Trichlorofluoromethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
P & M -Xylene	ND	2.00	0.620	ug/L	1	VMS10654	VXX19686	
Naphthalene	10.1	2.00	0.620	ug/L	1	VMS10654	VXX19686	
o-Xylene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Bromoform	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1-Chlorohexane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,2,4-Trimethylbenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
tert-Butylbenzene	0.610 J	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,1,1-Trichloroethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,1-Dichloroethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
2-Chlorotoluene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Trichloroethene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
trans-1,2-Dichloroethene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,2-Dichlorobenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
2,2-Dichloropropane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Hexachlorobutadiene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Isopropylbenzene (Cumene)	2.58	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,2-Dichloropropane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,1-Dichloropropene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,1,2-Trichloroethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,3-Dichlorobenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,2,3-Trichlorobenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,2-Dichloroethane-D4 <surr>	115	73-120		%	1	VMS10654	VXX19686	
Toluene-d8 <surr>	99.5	80-120		%	1	VMS10654	VXX19686	
4-Bromofluorobenzene <surr>	107	76-120		%	1	VMS10654	VXX19686	

**Batch Information**

Analytical Batch: VMS10654  
Analytical Method: SW8260B  
Analysis Date/Time: 07/20/09 22:09  
Dilution Factor: 1

Prep Batch: VXX19686  
Prep Method: SW5030B  
Prep Date/Time: 07/20/09 12:19

Initial Prep Wt./Vol.: 5 mL  
Prep Extract Vol.: 5 mL  
Container ID:1093515007-D  
Analyst: DSH



Client Sample ID: **RHMW02-WG16**  
SGS Ref. #: 1093515007  
Project ID: Red Hill BFSF  
Matrix: Water (Surface, Eff., Ground)

Collection Date/Time: 07/15/09 13:20  
Receipt Date/Time: 07/17/09 11:00

**Polynuclear Aromatics GC/MS**

<u>Parameter</u>	<u>Result</u>	<u>PQL/CL</u>	<u>MDL</u>	<u>Units</u>	<u>DF</u>	<u>Analytical Batch</u>	<u>Prep Batch</u>	<u>Qualifiers</u>
Acenaphthylene	ND	0.0521	0.0156	ug/L	1	XMS4994	XXX21226	
Acenaphthene	0.235	0.0521	0.0156	ug/L	1	XMS4994	XXX21226	
Fluorene	0.115	0.0521	0.0156	ug/L	1	XMS4994	XXX21226	
Phenanthrene	0.0304 J	0.0521	0.0156	ug/L	1	XMS4994	XXX21226	
Anthracene	ND	0.0521	0.0156	ug/L	1	XMS4994	XXX21226	
Fluoranthene	0.0247 J	0.0521	0.0156	ug/L	1	XMS4994	XXX21226	
Pyrene	0.0272 J	0.0521	0.0156	ug/L	1	XMS4994	XXX21226	
Benzo(a)Anthracene	ND	0.0521	0.0156	ug/L	1	XMS4994	XXX21226	
Chrysene	0.0162 J	0.0521	0.0156	ug/L	1	XMS4994	XXX21226	
Benzo[b]Fluoranthene	ND	0.0521	0.0156	ug/L	1	XMS4994	XXX21226	
Benzo[k]fluoranthene	ND	0.0521	0.0156	ug/L	1	XMS4994	XXX21226	
Benzo[a]pyrene	ND	0.0521	0.0156	ug/L	1	XMS4994	XXX21226	
Indeno[1,2,3-c,d] pyrene	ND	0.0521	0.0156	ug/L	1	XMS4994	XXX21226	
Dibenzo[a,h]anthracene	ND	0.0521	0.0156	ug/L	1	XMS4994	XXX21226	
Benzo[g,h,i]perylene	ND	0.0521	0.0156	ug/L	1	XMS4994	XXX21226	
Naphthalene	8.37	1.04	0.323	ug/L	10	XMS4996	XXX21226	
1-Methylnaphthalene	13.2	0.521	0.156	ug/L	10	XMS4996	XXX21226	
2-Methylnaphthalene	3.66	0.521	0.156	ug/L	10	XMS4996	XXX21226	
Terphenyl-d14 <sur>	84.9	50-135		%	1	XMS4994	XXX21226	

**Batch Information**

Analytical Batch: XMS4994	Prep Batch: XXX21226	Initial Prep Wt./Vol.: 960 mL
Analytical Method: 8270D SIMS	Prep Method: SW3520C	Prep Extract Vol.: 1 mL
Analysis Date/Time: 07/22/09 10:43	Prep Date/Time: 07/21/09 10:40	Container ID:1093515007-J
Dilution Factor: 1		Analyst: JDH
Analytical Batch: XMS4996	Prep Batch: XXX21226	Initial Prep Wt./Vol.: 960 mL
Analytical Method: 8270D SIMS	Prep Method: SW3520C	Prep Extract Vol.: 1 mL
Analysis Date/Time: 07/22/09 19:03	Prep Date/Time: 07/21/09 10:40	Container ID:1093515007-J
Dilution Factor: 10		Analyst: JDH



Client Sample ID: **RHMWA01-WG16**

SGS Ref. #: 1093515008

Project ID: Red Hill BFSF

Matrix: Water (Surface, Eff., Ground)

Collection Date/Time: 07/15/09 12:05

Receipt Date/Time: 07/17/09 11:00

**Dissolved Metals by ICP/MS**

<u>Parameter</u>	<u>Result</u>	<u>PQL/CL</u>	<u>MDL</u>	<u>Units</u>	<u>DF</u>	<u>Analytical</u> <u>Batch</u>	<u>Prep</u> <u>Batch</u>	<u>Qualifiers</u>
Lead	ND	1.00	0.310	ug/L	5	MMS5997	MXX21958	

**Batch Information**

Analytical Batch: MMS5997

Analytical Method: SW6020

Analysis Date/Time: 07/28/09 14:15

Dilution Factor: 5

Prep Batch: MXX21958

Prep Method: SW3010A

Prep Date/Time: 07/27/09 19:20

Initial Prep Wt./Vol.: 50 mL

Prep Extract Vol.: 50 mL

Container ID:1093515008-G

Analyst: NRB





Client Sample ID: **RHMWA01-WG16**

SGS Ref. #: 1093515008

Project ID: Red Hill BFSF

Matrix: Water (Surface, Eff., Ground)

Collection Date/Time: 07/15/09 12:05

Receipt Date/Time: 07/17/09 11:00

**Volatile Fuels Department**

<u>Parameter</u>	<u>Result</u>	<u>PQL/CL</u>	<u>MDL</u>	<u>Units</u>	<u>DF</u>	<u>Analytical Batch</u>	<u>Prep Batch</u>	<u>Qualifiers</u>
Gasoline Range Organics	ND	100	30.0	ug/L	1	VFC9556	VXX19707	
4-Bromofluorobenzene <sur>	103	50-150		%	1	VFC9556	VXX19707	

**Batch Information**

Analytical Batch: VFC9556

Analytical Method: SW8015C

Analysis Date/Time: 07/23/09 12:05

Dilution Factor: 1

Prep Batch: VXX19707

Prep Method: SW5030B

Prep Date/Time: 07/23/09 08:25

Initial Prep Wt./Vol.: 5 mL

Prep Extract Vol.: 5 mL

Container ID:1093515008-A

Analyst: KPW



Client Sample ID: **RHMWA01-WG16**

SGS Ref. #: 1093515008

Project ID: Red Hill BFSF

Matrix: Water (Surface, Eff., Ground)

Collection Date/Time: 07/15/09 12:05

Receipt Date/Time: 07/17/09 11:00

**Semivolatile Organic Fuels Department**

<u>Parameter</u>	<u>Result</u>	<u>PQL/CL</u>	<u>MDL</u>	<u>Units</u>	<u>DF</u>	<u>Analytical Batch</u>	<u>Prep Batch</u>	<u>Qualifiers</u>
Diesel Range Organics	1.30	0.400	0.150	mg/L	1	XFC8727	XXX21224	
5a Androstane <sur>	76.5	50-150		%	1	XFC8727	XXX21224	

**Batch Information**

Analytical Batch: XFC8727

Analytical Method: SW8015C

Analysis Date/Time: 07/30/09 03:48

Dilution Factor: 1

Prep Batch: XXX21224

Prep Method: SW3520C

Prep Date/Time: 07/21/09 10:15

Initial Prep Wt./Vol.: 1000 mL

Prep Extract Vol.: 1 mL

Container ID:1093515008-H

Analyst: KDC

Client Sample ID: **RHMWA01-WG16**

SGS Ref. #: 1093515008

Project ID: Red Hill BFSF

Matrix: Water (Surface, Eff., Ground)

Collection Date/Time: 07/15/09 12:05

Receipt Date/Time: 07/17/09 11:00

**Volatile Gas Chromatography/Mass Spectroscopy**

<u>Parameter</u>	<u>Result</u>	<u>PQL/CL</u>	<u>MDL</u>	<u>Units</u>	<u>DF</u>	<u>Analytical</u> <u>Batch</u>	<u>Prep</u> <u>Batch</u>	<u>Qualifiers</u>
Benzene	ND	0.400	0.120	ug/L	1	VMS10654	VXX19686	
Toluene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Ethylbenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
n-Butylbenzene	1.59	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,4-Dichlorobenzene	ND	0.500	0.150	ug/L	1	VMS10654	VXX19686	
1,2-Dichloroethane	ND	0.500	0.150	ug/L	1	VMS10654	VXX19686	
1,3,5-Trimethylbenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
4-Chlorotoluene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Chlorobenzene	ND	0.500	0.150	ug/L	1	VMS10654	VXX19686	
4-Methyl-2-pentanone (MIBK)	ND	10.0	3.10	ug/L	1	VMS10654	VXX19686	
cis-1,2-Dichloroethene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
4-Isopropyltoluene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
cis-1,3-Dichloropropene	ND	0.500	0.150	ug/L	1	VMS10654	VXX19686	
n-Propylbenzene	2.33	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Styrene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Dibromomethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
trans-1,3-Dichloropropene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,2,4-Trichlorobenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Acetone	ND	10.0	3.10	ug/L	1	VMS10654	VXX19686	
1,1,2,2-Tetrachloroethane	ND	0.500	0.150	ug/L	1	VMS10654	VXX19686	
1,2-Dibromo-3-chloropropane	ND	2.00	0.620	ug/L	1	VMS10654	VXX19686	
Methyl-t-butyl ether	ND	5.00	1.50	ug/L	1	VMS10654	VXX19686	
Tetrachloroethene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Dibromochloromethane	ND	0.500	0.150	ug/L	1	VMS10654	VXX19686	
1,3-Dichloropropane	ND	0.400	0.120	ug/L	1	VMS10654	VXX19686	
1,2-Dibromoethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Carbon tetrachloride	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,1,1,2-Tetrachloroethane	ND	0.500	0.150	ug/L	1	VMS10654	VXX19686	
Chloroform	ND	1.00	0.300	ug/L	1	VMS10654	VXX19686	
Bromobenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Chloromethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,2,3-Trichloropropane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Bromomethane	ND	3.00	0.940	ug/L	1	VMS10654	VXX19686	
Bromochloromethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Vinyl chloride	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Dichlorodifluoromethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	



Client Sample ID: **RHMWA01-WG16**

SGS Ref. #: 1093515008

Project ID: Red Hill BFSF

Matrix: Water (Surface, Eff., Ground)

Collection Date/Time: 07/15/09 12:05

Receipt Date/Time: 07/17/09 11:00

**Volatile Gas Chromatography/Mass Spectroscopy**

<u>Parameter</u>	<u>Result</u>	<u>PQL/CL</u>	<u>MDL</u>	<u>Units</u>	<u>DF</u>	<u>Analytical Batch</u>	<u>Prep Batch</u>	<u>Qualifiers</u>
Chloroethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
sec-Butylbenzene	3.23	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Bromodichloromethane	ND	0.500	0.150	ug/L	1	VMS10654	VXX19686	
1,1-Dichloroethene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
2-Butanone (MEK)	ND	10.0	3.10	ug/L	1	VMS10654	VXX19686	
Methylene chloride	ND	5.00	1.00	ug/L	1	VMS10654	VXX19686	
Trichlorofluoromethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
P & M -Xylene	ND	2.00	0.620	ug/L	1	VMS10654	VXX19686	
Naphthalene	11.2	2.00	0.620	ug/L	1	VMS10654	VXX19686	
o-Xylene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Bromoform	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1-Chlorohexane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,2,4-Trimethylbenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
tert-Butylbenzene	0.560 J	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,1,1-Trichloroethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,1-Dichloroethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
2-Chlorotoluene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Trichloroethene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
trans-1,2-Dichloroethene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,2-Dichlorobenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
2,2-Dichloropropane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Hexachlorobutadiene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
Isopropylbenzene (Cumene)	2.36	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,2-Dichloropropane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,1-Dichloropropene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,1,2-Trichloroethane	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,3-Dichlorobenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,2,3-Trichlorobenzene	ND	1.00	0.310	ug/L	1	VMS10654	VXX19686	
1,2-Dichloroethane-D4 <surr>	111	73-120		%	1	VMS10654	VXX19686	
Toluene-d8 <surr>	99.8	80-120		%	1	VMS10654	VXX19686	
4-Bromofluorobenzene <surr>	105	76-120		%	1	VMS10654	VXX19686	

**Batch Information**

Analytical Batch: VMS10654  
Analytical Method: SW8260B  
Analysis Date/Time: 07/20/09 22:40  
Dilution Factor: 1

Prep Batch: VXX19686  
Prep Method: SW5030B  
Prep Date/Time: 07/20/09 12:19

Initial Prep Wt./Vol.: 5 mL  
Prep Extract Vol.: 5 mL  
Container ID: 1093515008-D  
Analyst: DSH



Client Sample ID: **RHMWA01-WG16**

SGS Ref. #: 1093515008

Project ID: Red Hill BFSF

Matrix: Water (Surface, Eff., Ground)

Collection Date/Time: 07/15/09 12:05

Receipt Date/Time: 07/17/09 11:00

**Polynuclear Aromatics GC/MS**

<u>Parameter</u>	<u>Result</u>	<u>PQL/CL</u>	<u>MDL</u>	<u>Units</u>	<u>DF</u>	<u>Analytical Batch</u>	<u>Prep Batch</u>	<u>Qualifiers</u>
Acenaphthylene	ND	0.0549	0.0165	ug/L	1	XMS4994	XXX21226	
Acenaphthene	0.213	0.0549	0.0165	ug/L	1	XMS4994	XXX21226	
Fluorene	0.108	0.0549	0.0165	ug/L	1	XMS4994	XXX21226	
Phenanthrene	0.0291 J	0.0549	0.0165	ug/L	1	XMS4994	XXX21226	
Anthracene	ND	0.0549	0.0165	ug/L	1	XMS4994	XXX21226	
Fluoranthene	0.0199 J	0.0549	0.0165	ug/L	1	XMS4994	XXX21226	
Pyrene	0.0189 J	0.0549	0.0165	ug/L	1	XMS4994	XXX21226	
Benzo(a)Anthracene	ND	0.0549	0.0165	ug/L	1	XMS4994	XXX21226	
Chrysene	ND	0.0549	0.0165	ug/L	1	XMS4994	XXX21226	
Benzo[b]Fluoranthene	ND	0.0549	0.0165	ug/L	1	XMS4994	XXX21226	
Benzo[k]fluoranthene	ND	0.0549	0.0165	ug/L	1	XMS4994	XXX21226	
Benzo[a]pyrene	ND	0.0549	0.0165	ug/L	1	XMS4994	XXX21226	
Indeno[1,2,3-c,d] pyrene	ND	0.0549	0.0165	ug/L	1	XMS4994	XXX21226	
Dibenzo[a,h]anthracene	ND	0.0549	0.0165	ug/L	1	XMS4994	XXX21226	
Benzo[g,h,i]perylene	ND	0.0549	0.0165	ug/L	1	XMS4994	XXX21226	
Naphthalene	6.71	1.10	0.341	ug/L	10	XMS4996	XXX21226	
1-Methylnaphthalene	10.6	0.549	0.165	ug/L	10	XMS4996	XXX21226	
2-Methylnaphthalene	2.58	0.0549	0.0165	ug/L	1	XMS4994	XXX21226	
Terphenyl-d14 <sur>	94.2	50-135		%	1	XMS4994	XXX21226	

**Batch Information**

Analytical Batch: XMS4994	Prep Batch: XXX21226	Initial Prep Wt./Vol.: 910 mL
Analytical Method: 8270D SIMS	Prep Method: SW3520C	Prep Extract Vol.: 1 mL
Analysis Date/Time: 07/22/09 11:17	Prep Date/Time: 07/21/09 10:40	Container ID:1093515008-J
Dilution Factor: 1		Analyst: JDH
Analytical Batch: XMS4996	Prep Batch: XXX21226	Initial Prep Wt./Vol.: 910 mL
Analytical Method: 8270D SIMS	Prep Method: SW3520C	Prep Extract Vol.: 1 mL
Analysis Date/Time: 07/22/09 19:36	Prep Date/Time: 07/21/09 10:40	Container ID:1093515008-J
Dilution Factor: 10		Analyst: JDH